


	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	5.477	7,8	738	333	7,4	67	9	91	97
2	4.435								
3	5.535								
4	4.917								
5	4.781								
6	5.007	7,7	738	320	7,4	69	8	91	97
7	7.232	7,7	746	306	7,5	69	7	91	98
8	7.004	7,7	786	313	7,6	43	3	95	99
9	5.017								
10	4.635								
11	5.215	7,7	754	300	7,5	55	10	93	97
12	6.298	7,7	730	280	7,6	55	4	92	98
13	8.515	7,6	754	300	7,6	58	9	92	97
14	8.578	7,6	681	372	7,6	63	8	91	98
15	5.085	7,7	770	322	7,6	57	7	93	98
16	5.358								
17	4.444								
18	4.565	7,4	665	280	7,6	56	7	92	98
19	4.625	7,8	738	320	7,4	66	8	91	97
20	4.524	7,5	641	260	7,3	60	7	91	97
21	4.258	7,7	722	306	7,6	57	7	92	98
22	4.458	7,7	778	328	7,6	50	4	94	99
23	4.481								
24	4.100								
25	3.857	7,7	778	320	7,3	62	6	92	98
26	4.199	7,7	722	300	7,4	65	6	91	98
27	6.811	7,5	697	290	7,2	61	6	91	98
28	8.387	7,6	746	333	7,3	67	8	91	98
29	5.852	7,5	697	275	7,4	50	7	93	97
30	5.090								
31	8.377								
MED	5.520	7,6	731	308	7,5	60	7	92	98
MIN	3.857	7,4	641	260	7,2	43	3	91	97
MAX	8.578	7,8	786	372	7,6	69	10	95	99
TOTAL	171.117	-	-	-	-	-	-	-	-

	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	11.660	7,3	762	361	7,5	70	10	91	97
2	13.695								
3	12.771								
4	11.776								
5	11.938								
6	10.530	7,4	842	400	7,5	57	7	93	98
7	11.795	7,6	786	325	8,0	64	11	92	97
8	11.801	7,6	850	369	7,7	75	10	91	97
9	11.515								
10	11.385								
11	10.624	7,6	818	420	7,8	59	6	93	99
12	11.925	7,5	778	360	8,3	51	10	93	97
13	12.284	7,6	826	375	7,7	53	3	94	99
14	10.939	7,6	714	372	7,7	57	5	92	99
15	10.717	7,6	826	406	7,9	61	8	93	98
16	10.998								
17	10.485								
18	9.647	8,0	746	300	8,1	48	8	94	97
19	12.720	7,7	826	340	7,8	67	5	92	99
20	12.704	7,4	593	232	8,6	76	4	87	98
21	11.019	7,8	770	344	8,5	48	4	94	99
22	11.425	7,7	923	421	7,7	64	9	93	98
23	9.668								
24	11.891								
25	10.321	7,6	544	260	7,8	75	11	86	96
26	11.434	7,7	794	360	8,5	64	10	92	97
27	10.716	7,5	842	425	7,4	64	10	92	98
28	10.410	7,5	858	438	7,6	62	7	93	98
29	10.277	7,5	826	425	7,8	69	11	92	97
30	10.838								
31	12.493								
MED	11.368	7,6	785	365	7,9	62	8	92	98
MIN	9.647	7,3	544	232	7,4	48	3	86	96
MAX	13.695	8,0	923	438	8,6	76	11	94	99
TOTAL	352.401	-	-	-	-	-	-	-	-

Rendimientos EDAR La Barrosa - Enero'09

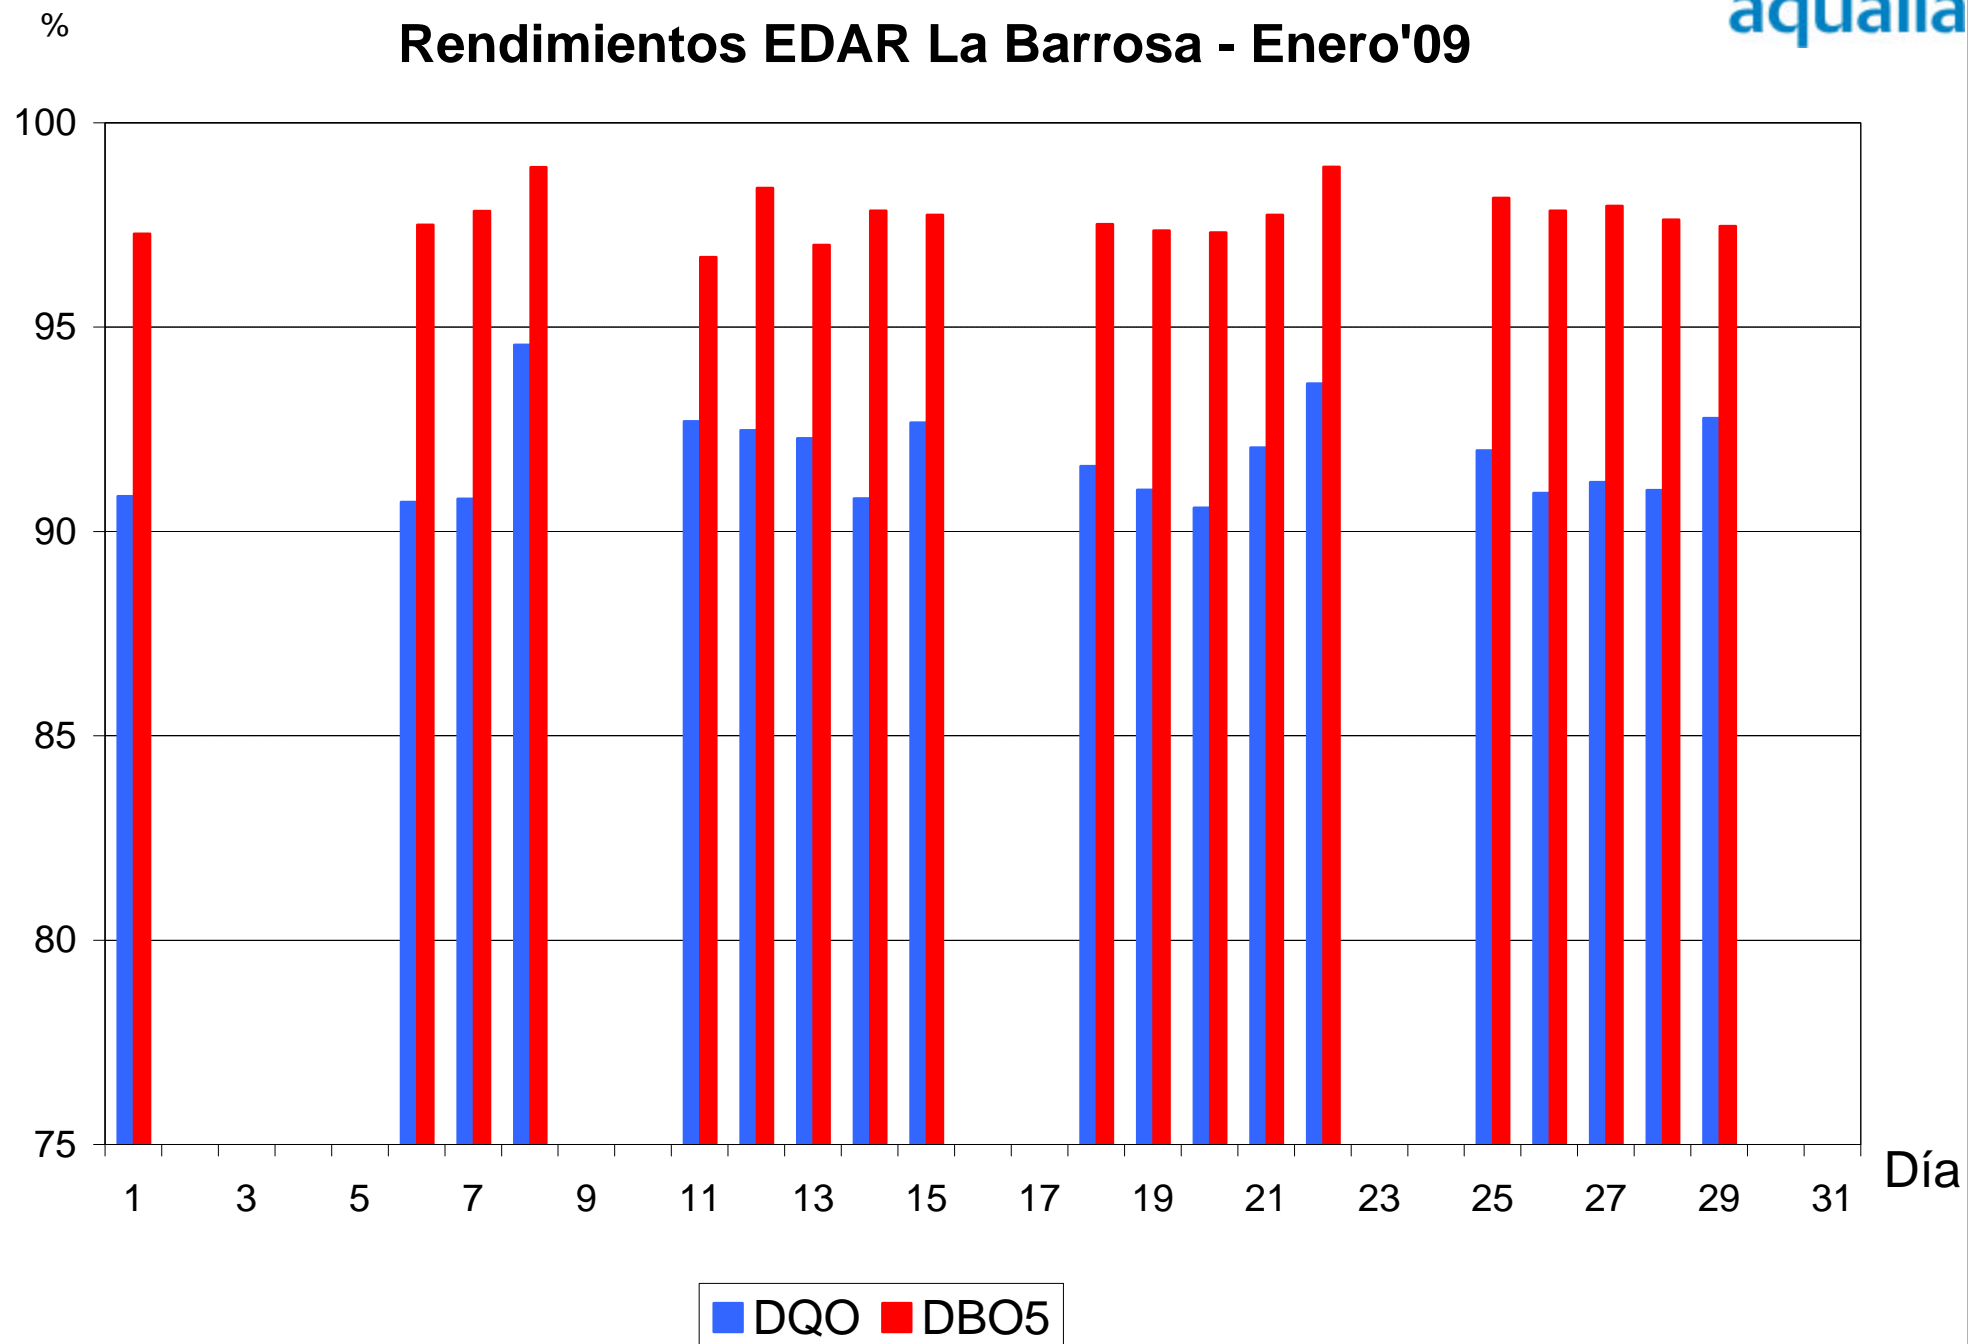

Rendimientos EDAR El Torno - Enero'09

