


| | Caudal entrada | AGUA BRUTA | | | AGUA TRATADA | | | REND. ELIMINACION | |
|-------|-------------------|------------|--------|---------|--------------|--------|---------|-------------------|---------|
| | | pH | D.Q.O. | D.B.O.5 | pH | D.Q.O. | D.B.O.5 | D.Q.O. | D.B.O.5 |
| Día | m3/día | - | mg/l | mg/l | - | mg/l | mg/l | % | % |
| 1 | 13.332 | 7,5 | 869 | 319 | 7,3 | 108 | 26 | 88 | 92 |
| 2 | 11.008 | 7,2 | 803 | 444 | 7,2 | 111 | 16 | 86 | 96 |
| 3 | 10.643 | 7,4 | 976 | 521 | 7,4 | 129 | 14 | 87 | 97 |
| 4 | 11.103 | | | | | | | | |
| 5 | 9.704 | | | | | | | | |
| 6 | 9.366 | | | | | | | | |
| 7 | 10.132 | | | | | | | | |
| 8 | 10.098 | 7,2 | 1.001 | 400 | 7,3 | 141 | 11 | 86 | 97 |
| 9 | 10.133 | 7,3 | 836 | 375 | 7,6 | 124 | 14 | 85 | 96 |
| 10 | 9.514 | | | | | | | | |
| 11 | 9.728 | | | | | | | | |
| 12 | 9.050 | | | | | | | | |
| 13 | 8.785 | 7,2 | 861 | 380 | 7,3 | 93 | 5 | 89 | 99 |
| 14 | 9.537 | 7,2 | 910 | 480 | 7,5 | 91 | 8 | 90 | 98 |
| 15 | 9.463 | 7,4 | 894 | 433 | 7,4 | 113 | 20 | 87 | 95 |
| 16 | 11.582 | 7,2 | 852 | 419 | 7,4 | 109 | 14 | 87 | 97 |
| 17 | 10.214 | 7,3 | 952 | 500 | 7,5 | 93 | 40 | 90 | 92 |
| 18 | 10.953 | | | | | | | | |
| 19 | 10.954 | | | | | | | | |
| 20 | 9.666 | | | | | | | | |
| 21 | 11.295 | 7,0 | 1.051 | 400 | 6,9 | 124 | 8 | 88 | 98 |
| 22 | 11.751 | 7,0 | 952 | 471 | 6,9 | 129 | 10 | 86 | 98 |
| 23 | 12.365 | | | | | | | | |
| 24 | 13.929 | | | | | | | | |
| 25 | 8.325 | | | | | | | | |
| 26 | 12.045 | | | | | | | | |
| 27 | 13.423 | 7,0 | 869 | 380 | 7,0 | 119 | 23 | 86 | 94 |
| 28 | 8.883 | 7,2 | 736 | 340 | 7,2 | 99 | 10 | 87 | 97 |
| 29 | 10.802 | 7,3 | 596 | 232 | 7,5 | 91 | 14 | 85 | 94 |
| 30 | 12.116 | | | | | | | | |
| 31 | 12.420 | | | | | | | | |
| MED | 10.720 | 7,2 | 877 | 406 | 7,3 | 112 | 16 | 87 | 96 |
| MIN | 8.325 | 7,0 | 596 | 232 | 6,9 | 91 | 5 | 85 | 92 |
| MAX | 13.929 | 7,5 | 1.051 | 521 | 7,6 | 141 | 40 | 90 | 99 |
| TOTAL | 332.320 | - | - | - | - | - | - | - | - |

Rendimientos EDAR El Torno - Diciembre'09

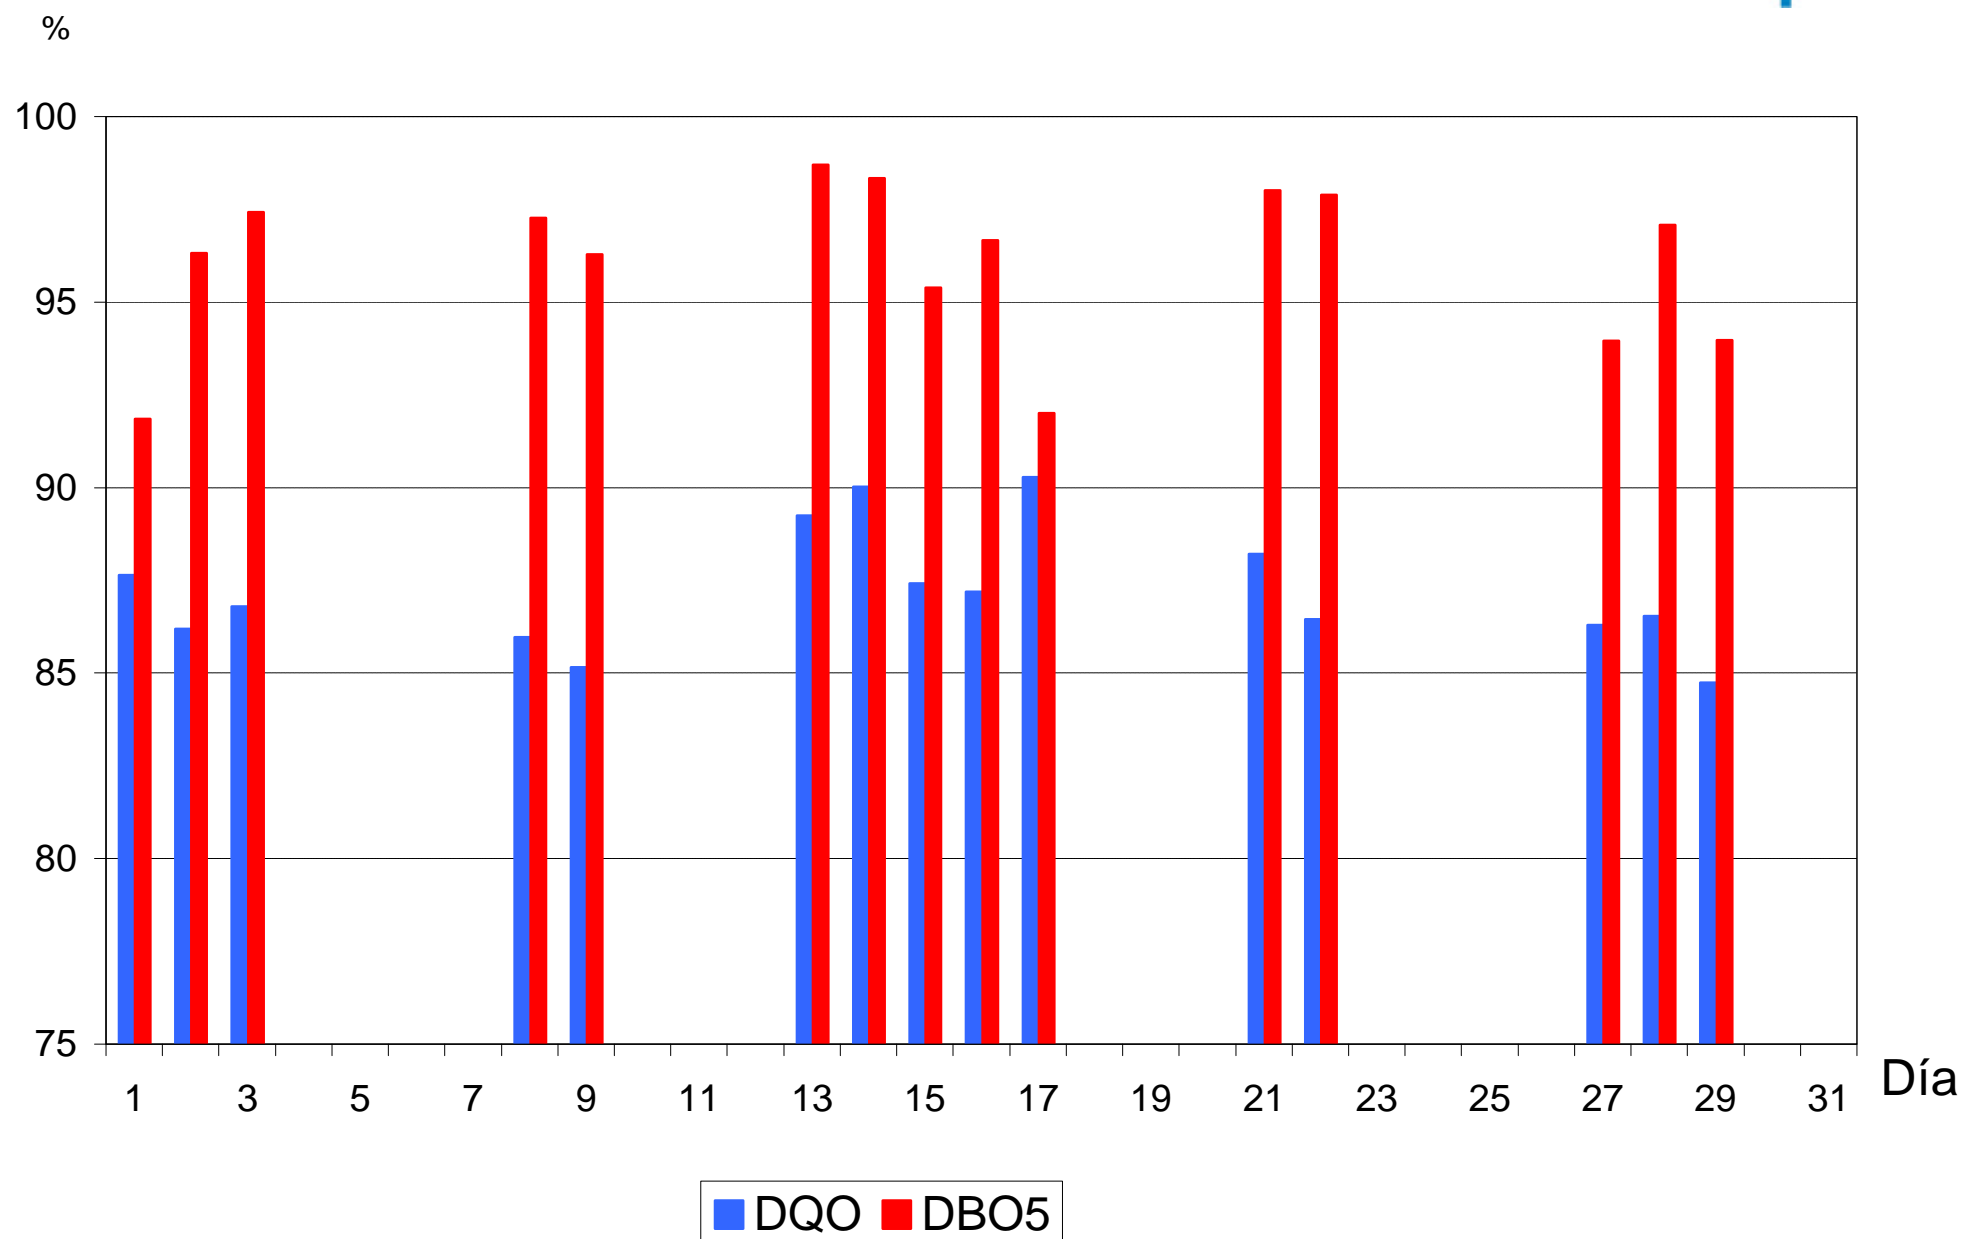

| | Caudal entrada | AGUA BRUTA | | | AGUA TRATADA | | | REND. ELIMINACION | |
|-------|-------------------|------------|--------|---------|--------------|--------|---------|-------------------|---------|
| | | pH | D.Q.O. | D.B.O.5 | pH | D.Q.O. | D.B.O.5 | D.Q.O. | D.B.O.5 |
| Día | m3/día | - | mg/l | mg/l | - | mg/l | mg/l | % | % |
| 1 | 5.023 | 7,4 | 827 | 375 | 7,4 | 103 | 7 | 88 | 98 |
| 2 | 6.444 | 7,3 | 794 | 363 | 7,3 | 101 | 11 | 87 | 97 |
| 3 | 5.140 | 7,3 | 811 | 363 | 7,3 | 104 | 15 | 87 | 96 |
| 4 | 5.120 | | | | | | | | |
| 5 | 5.546 | | | | | | | | |
| 6 | 5.735 | | | | | | | | |
| 7 | 5.731 | | | | | | | | |
| 8 | 5.689 | 7,4 | 885 | 375 | 7,6 | 112 | 13 | 87 | 97 |
| 9 | 4.912 | 7,6 | 819 | 350 | 7,2 | 114 | 13 | 86 | 96 |
| 10 | 4.776 | | | | | | | | |
| 11 | 4.463 | | | | | | | | |
| 12 | 5.093 | | | | | | | | |
| 13 | 4.887 | 7,5 | 678 | 340 | 7,3 | 96 | 9 | 86 | 97 |
| 14 | 4.406 | 7,5 | 844 | 400 | 6,7 | 93 | 14 | 89 | 96 |
| 15 | 4.505 | 7,4 | 885 | 329 | 6,9 | 104 | 13 | 88 | 96 |
| 16 | 7.126 | 7,2 | 885 | 388 | 7,2 | 100 | 12 | 89 | 97 |
| 17 | 4.970 | 7,2 | 852 | 375 | 6,9 | 98 | 12 | 89 | 97 |
| 18 | 10.551 | | | | | | | | |
| 19 | 6.317 | | | | | | | | |
| 20 | 6.797 | | | | | | | | |
| 21 | 14.712 | 7,1 | 894 | 380 | 7,1 | 127 | 8 | 86 | 98 |
| 22 | 12.859 | 7,0 | 794 | 388 | 7,0 | 96 | 9 | 88 | 98 |
| 23 | 12.262 | | | | | | | | |
| 24 | 12.337 | | | | | | | | |
| 25 | 14.081 | | | | | | | | |
| 26 | 11.183 | | | | | | | | |
| 27 | 8.682 | 7,1 | 786 | 360 | 7,5 | 104 | 12 | 87 | 97 |
| 28 | 9.098 | 7,3 | 786 | 280 | 7,2 | 86 | 11 | 89 | 96 |
| 29 | 8.809 | 7,0 | 687 | 320 | 7,1 | 79 | 9 | 89 | 97 |
| 30 | 8.386 | | | | | | | | |
| 31 | 8.844 | | | | | | | | |
| MED | 7.564 | 7,3 | 815 | 359 | 7,2 | 101 | 11 | 88 | 97 |
| MIN | 4.406 | 7,0 | 678 | 280 | 6,7 | 79 | 7 | 86 | 96 |
| MAX | 14.712 | 7,6 | 894 | 400 | 7,6 | 127 | 15 | 89 | 98 |
| TOTAL | 234.484 | - | - | - | - | - | - | - | - |

Rendimientos EDAR La Barrosa - Diciembre'09

