


	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	7.517	7,0	500	166	7,2	18	7	96	96
2	9.023	7,1	500	165	7,3	15	5	97	97
3	7.728	7,8	784	320	7,7	44	13	94	96
4	8.795								
5	8.646								
6	7.396								
7	8.460								
8	8.373	7,7	853	360	7,6	38	8	95	98
9	9.032	7,4	832	320	7,6	44	13	95	96
10	9.356	7,7	920	368	7,7	51	10	94	97
11	8.895	7,7	1.083	492	7,7	55	15	95	97
12	9.325	7,4	915	457	7,9	45	11	95	98
13	9.970								
14	6.771								
15	8.356	7,5	671	480	7,6	35	9	95	98
16	8.925	8,0	679	320	8,5	46	14	93	96
17	8.253	7,8	926	336	7,9	51	9	94	97
18	9.526	7,9	804	381	7,9	55	12	93	97
19	8.895	7,6	836	394	7,7	30	8	96	98
20	6.816								
21	8.271								
22	7.856	7,8	865	500	7,7	34	5	96	99
23	8.545	7,5	1.036	520	7,6	42	11	96	98
24	8.725	7,0	1.072	388	7,5	51	4	95	99
25	8.507	7,6	651	323	7,8	38	8	94	98
26	10.119	7,6	1.447	990	7,7	41	5	97	99
27	10.233								
28	8.567								
29	8.180	7,7	659	360	7,7	38	9	94	98
30	9.071	7,8	887	520	7,9	24	3	97	99
31	9.170	7,6	805	256	7,6	27	4	97	98
MED	8.623	7,6	844	401	7,7	39	9	95	98
MIN	6.771	7,0	500	165	7,2	15	3	93	96
MAX	10.233	8,0	1.447	990	8,5	55	15	97	99
TOTAL	267.302	-	-	-	-	-	-	-	-

Rendimientos EDAR El Torno - Enero'17

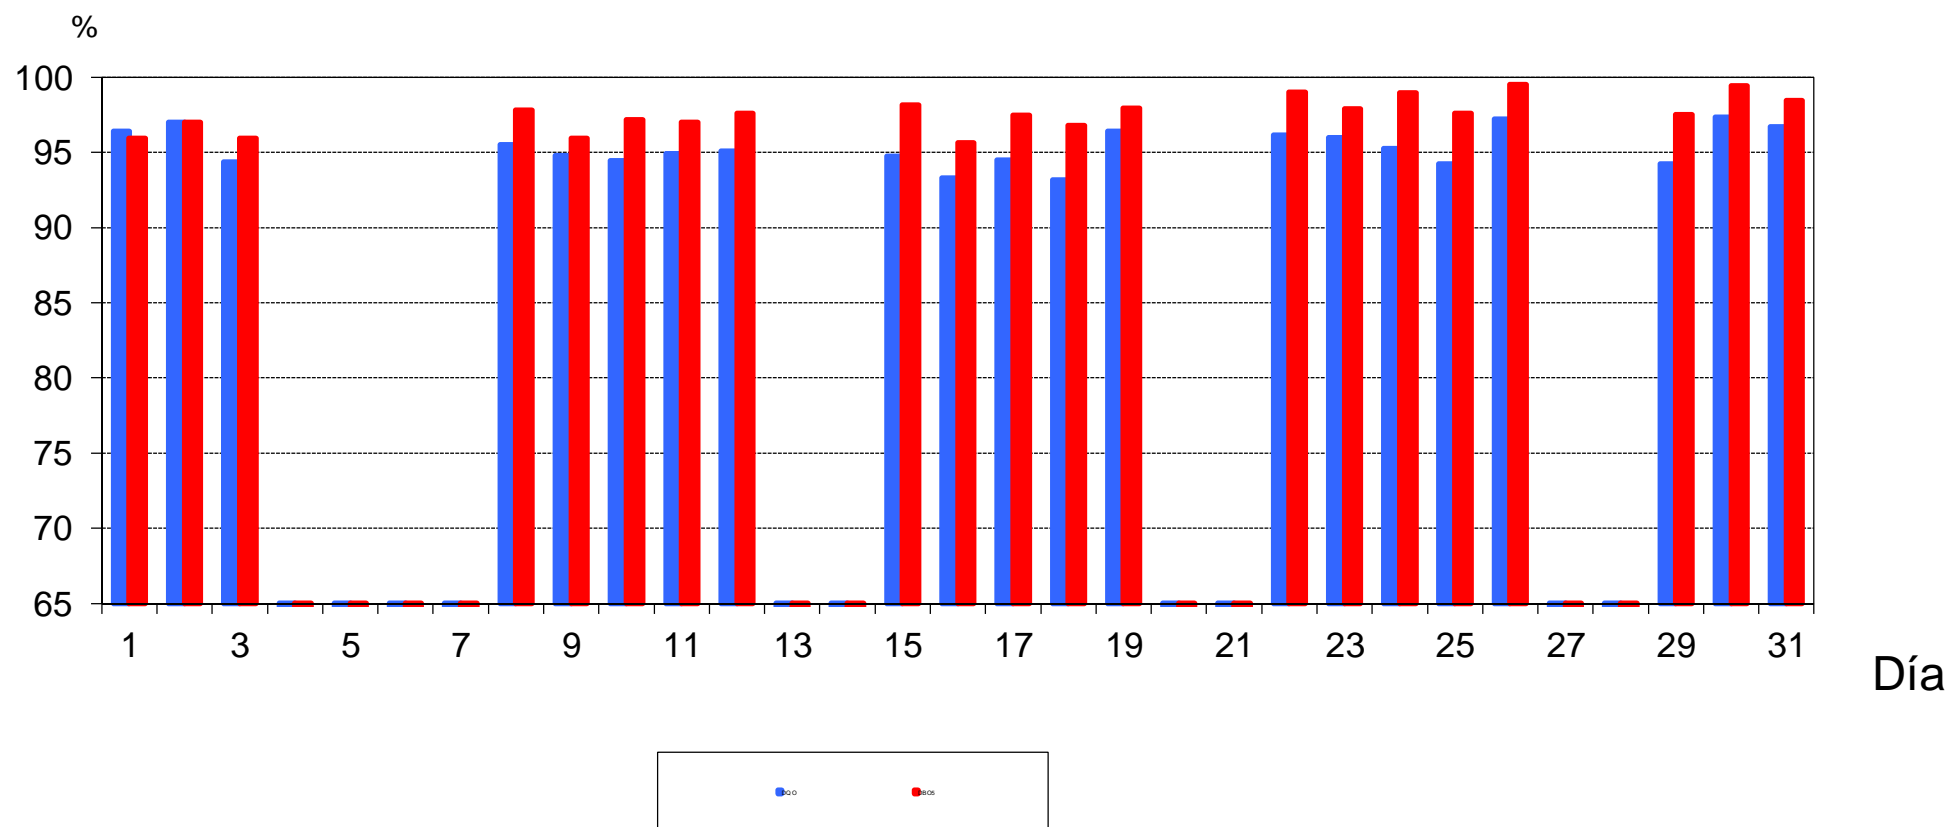

	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	2.592	7,3	180	39	7,0	15	5	92	87
2	2.270	7,4	140	27	7,1	15	5	89	81
3	2.457	7,8	341	180	7,7	31	7	91	96
4	2.272								
5	2.412								
6	2.136								
7	2.329								
8	2.360	7,8	234	120	7,8	23	5	90	96
9	2.472	8,0	342	180	7,9	23	8	93	96
10	2.709	7,8	364	171	8,0	22	6	94	96
11	2.728	7,8	207	113	7,7	23	6	89	95
12	2.433	7,6	310	152	7,7	16	6	95	96
13	2.553								
14	2.345								
15	2.290	8,0	332	160	7,4	26	7	92	95
16	2.715	8,0	421	240	7,7	22	4	95	98
17	2.785	7,9	398	127	7,9	27	4	93	97
18	2.269	8,0	246	113	7,8	25	6	90	95
19	2.262	7,4	367	178	7,2	21	5	94	97
20	2.373								
21	2.240								
22	2.371	7,8	383	160	7,8	31	6	92	96
23	2.399	8,1	320	150	7,4	32	6	90	96
24	2.341	7,8	308	158	7,6	25	3	92	98
25	2.639	7,8	343	143	7,4	21	4	94	97
26	5.112	7,9	423	144	7,8	51	13	88	91
27	3.227								
28	2.860								
29	2.746	7,7	324	140	7,9	20	9	94	94
30	2.678	7,8	384	160	7,9	19	7	95	96
31	2.595	7,9	449	126	7,6	11	2	97	99
MED	2.580	7,8	325	142	7,6	24	6	92	95
MIN	2.136	7,3	140	27	7,0	11	2	88	81
MAX	5.112	8,1	449	240	8,0	51	13	97	99
TOTAL	79.970	-	-	-	-	-	-	-	-

Rendimientos EDAR La Barrosa - Enero'17

