


	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	6.725								
2	8.133								
3	7.607								
4	6.962								
5	7.716								
6	6.508	7,3	678	340	7,4	58	24	91	93
7	7.830	7,4	717	440	7,0	71	17	90	96
8	8.048	7,6	672	251	7,8	64	4	90	98
9	7.987								
10	7.825								
11	7.268	7,6	678	320	7,0	71	16	90	95
12	7.858	7,5	691	280	7,1	78	10	89	96
13	9.331	7,7	691	199	7,4	75	5	89	97
14	7.143	7,4	710	195	7,1	65	3	91	98
15	8.884	7,1	717	265	7,1	65	4	91	98
16	9.385								
17	9.412								
18	9.797	7,2	749	320	6,8	74	7	90	98
19	10.019	7,6	903	380	7,3	69	10	92	97
20	10.056	7,7	729	111	7,5	79	8	89	93
21	9.841	7,5	800	259	7,2	78	4	90	98
22	9.013	7,6	678	151	7,5	78	5	88	97
23	8.979								
24	8.413	7,6	614	240	7,8	82	8		
25	7.394	7,4	691	380	7,3	78	3	87	97
26	8.480	7,5	839	186	7,3	82	7	89	99
27	8.078	7,5	839	186	7,3	82	7	90	96
28	8.417	7,5	839	311	7,5	76	5	91	98
29	7.905	7,5	723	282	7,5	76	4	89	99
30	8.707								
31	8.161								
MED	8.319	7,5	735	268	7,3	74	8	90	97
MIN	6.508	7,1	614	111	6,8	58	3	87	93
MAX	10.056	7,7	903	440	7,8	82	24	92	99
TOTAL	257.882	-	-	-	-	-	-	-	-

## Rendimientos EDAR El Torno - Enero'15

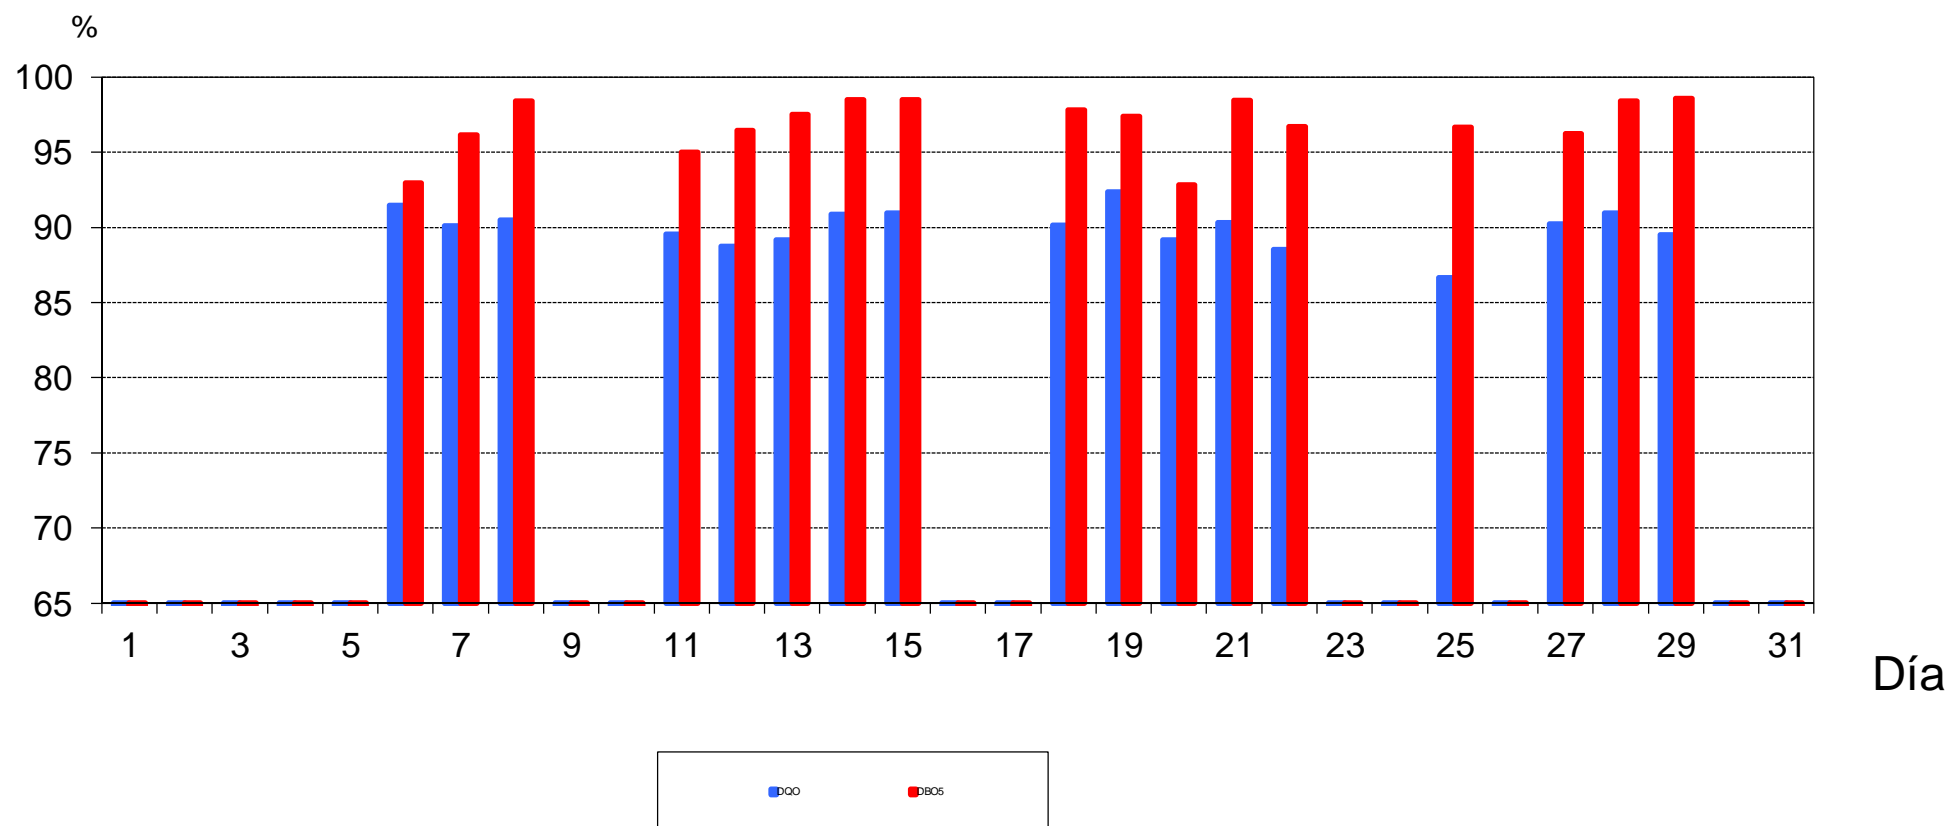

	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	3.343								
2	3.486								
3	3.440								
4	3.147								
5	3.050								
6	3.005	7,5	717	360	7,3	63	9	91	97
7	3.358	7,5	755	440	7,2	62	11	92	97
8	3.469	7,9	710	216	7,5	59	3	92	99
9	3.323								
10	3.369								
11	3.057	7,5	665	260	7,0	63	15	90	94
12	3.111	7,6	646	260	7,2	68	14	89	94
13	3.023	7,5	723	146	6,7	64	2	91	99
14	3.116	7,5	807	200	6,8	72	2	91	99
15	5.413	7,6	826	264	6,7	67	3	92	99
16	4.458								
17	5.761								
18	9.101	7,2	826	380	7,0	66	5	92	99
19	6.738	7,8	807	340	7,4	62	11	92	97
20	9.507	7,8	736	157	7,2	65	4	91	98
21	7.729	8,0	466	100	7,6	63	3	86	97
22	5.116	7,9	614	114	7,2	67	3	89	97
23	4.175								
24	3.988								
25	3.896	7,6	678	260	6,9	65	14	91	91
26	3.755	7,7	742	125	7,1	79	9	88	97
27	3.536	7,7	742	125	7,0	51	2	93	98
28	3.522	7,6	742	182	7,3	61	3	92	98
29	3.606	7,6	562	179	7,6	57	2		
30	4.416								
31	#¡REF!								
MED	#¡REF!	7,6	709	228	7,2	64	6	91	97
MIN	#¡REF!	7,2	466	100	6,7	51	2	86	91
MAX	#¡REF!	8,0	826	440	7,6	79	15	93	99
TOTAL	#¡REF!	-	-	-	-	-	-	-	-

## Rendimientos EDAR La Barrosa - Enero'15

