



Rendimientos EDAR EI Torno - Agosto'15

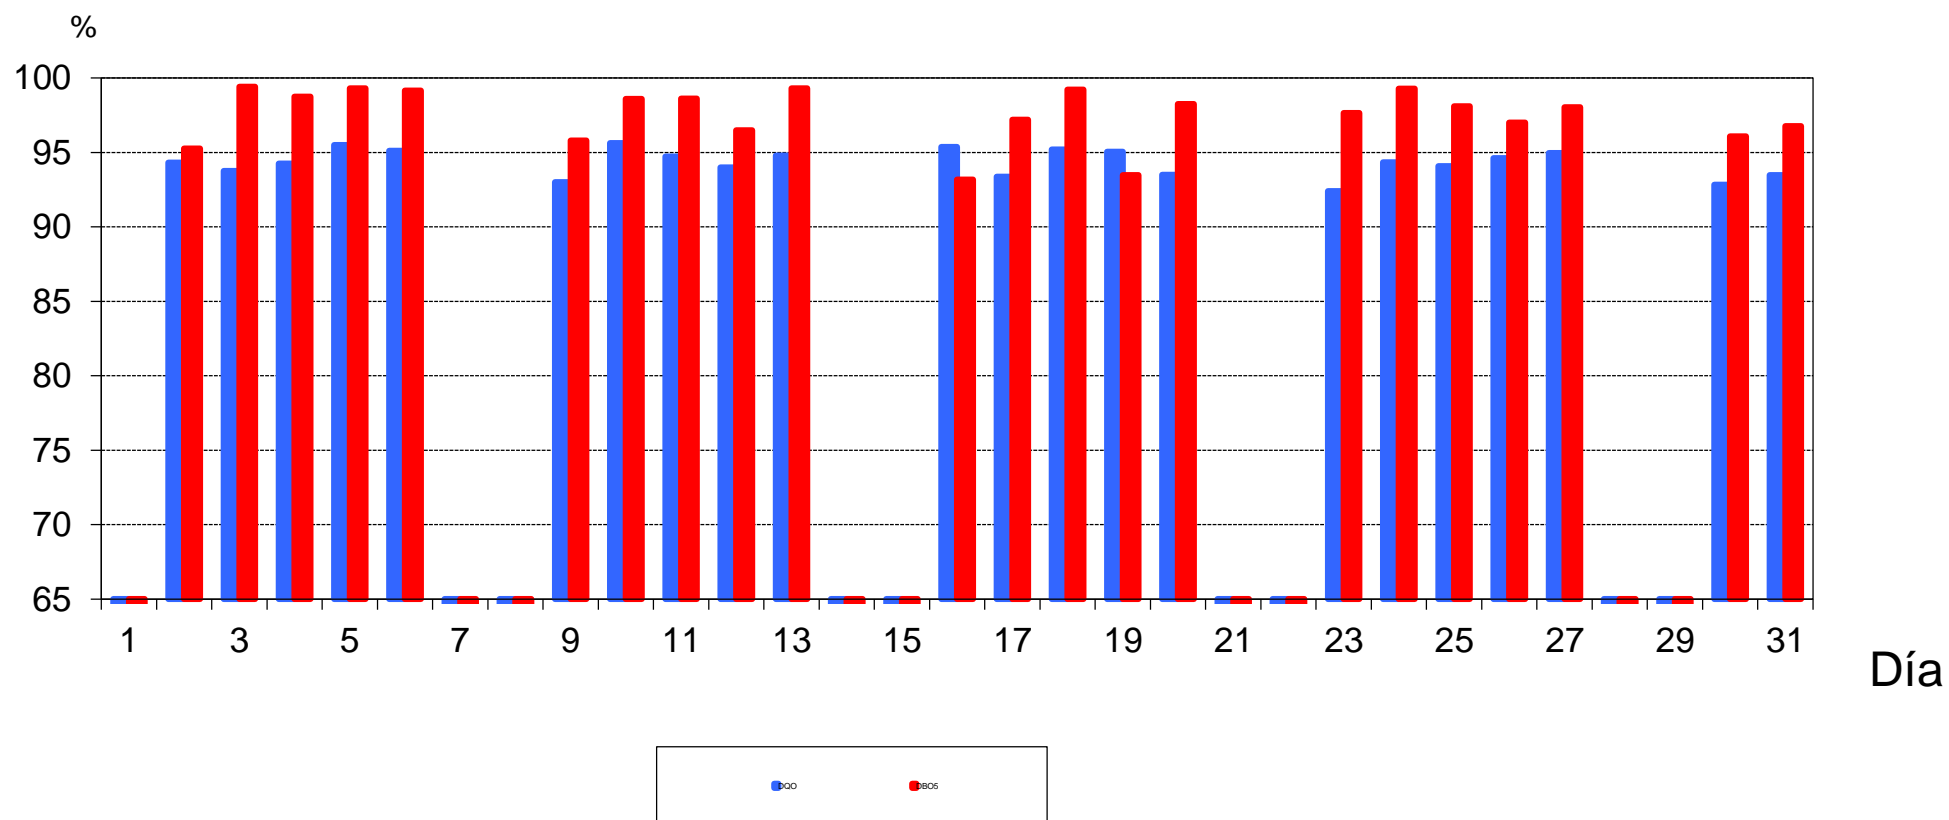

Rendimientos EDAR EI Torno - Agosto'15

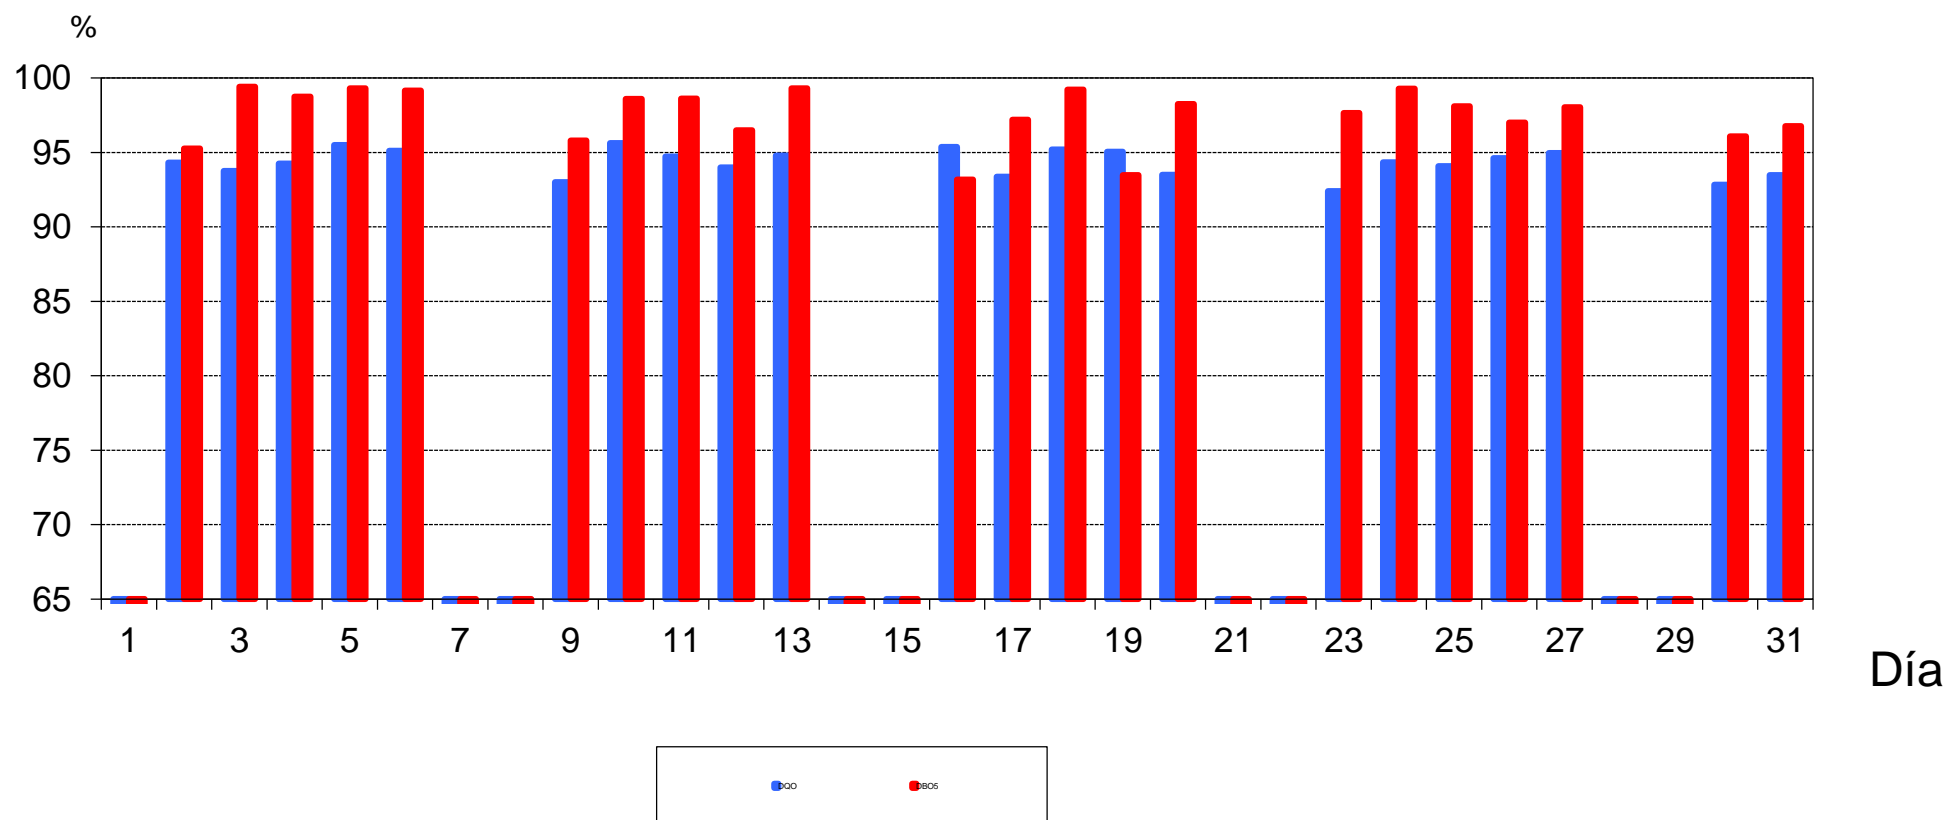

	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	5.553								
2	7.041	7,5	579	240	7,0	52	12	91	95
3	8.973	7,6	609	240	7,5	57	22	91	91
4	12.099	7,5	572	293	7,6	44	7	92	98
5	11.858	7,6	560	307	7,5	56	9	90	97
6	10.884	7,5	530	348	7,6	61	12	89	97
7	11.211								
8	12.040								
9	11.684	7,4	555	300	7,4	31	10	94	97
10	11.615	7,6	513	320	7,4	29	9	94	97
11	11.375	7,7	662	439	7,3	29	2	96	99
12	11.317	7,4	585	431	7,2	37	11	94	97
13	11.279	7,5	601	259	7,7	38	8	94	97
14	11.880								
15	11.038								
16	10.665	7,6	664	320	7,2	35	12	95	96
17	10.815	7,5	1.324	600	7,6	38	15	97	97
18	10.661	7,6	1.150	438	7,5	34	3	97	99
19	11.001	7,7	1.048	470	7,4	25	12	98	97
20	11.163	7,4	608	308	7,5	31	3	95	99
21	10.978								
22	11.205								
23	10.198	7,5	555	240	7,8	46	7	92	97
24	10.450	7,8	564	320	7,7	28	3	95	99
25	10.540	7,5	597	409	7,5	26	4	96	99
26	10.501	7,4	527	336	7,5	27	11	95	97
27	10.098	7,5	520	235	7,6	28	3	95	99
28	10.645								
29	10.179								
30	8.439	7,5	541	360	7,3	35	15	93	96
31	#¡REF!	7,7	612	300	7,5	58	17	91	94
MED	#¡REF!	7,5	658	342	7,5	38	9	94	97
MIN	#¡REF!	7,4	513	235	7,0	25	2	89	91
MAX	#¡REF!	7,8	1.324	600	7,8	61	22	98	99
TOTAL	#¡REF!	-	-	-	-	-	-	-	-

Rendimientos EDAR La Barrosa - Agosto'15

