


	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	8.910	7,6	667	335	7,4	61	6	91	98
2	8.804	7,2	767	423	7,6	41	13	95	97
3	8.922	7,4	713	339	7,4	58	13	92	96
4	8.795								
5	8.691								
6	8.047								
7	8.895								
8	8.041	7,4	660	380	7,5	49	2	93	99
9	8.753	7,2	723	320	7,2	41	15	94	95
10	8.982	7,0	933	451	7,1	55	15	94	97
11	8.611								
12	9.959								
13	7.645	7,4	595	400	7,2	48	20	92	95
14	7.856	7,3	648	440	7,7	40	18	94	96
15	7.869	7,2	657	339	7,1	69	11	89	97
16	7.720	7,6	679	390	7,5	80	25	88	94
17	7.848	7,2	752	403	7,3	82	13	89	97
18	8.396								
19	7.686								
20	7.353	7,4	704	460	7,6	51	19	93	96
21	8.015	7,1	728	400	7,4	63	23	91	94
22	8.038	7,2	435	162	7,5	80	20	82	88
23	8.121								
24	8.922								
25	7.093								
26	7.744								
27	7.178	7,2	717	320	7,4	63	19	91	94
28	8.946	7,4	639	300	7,4	42	8	93	97
29	8.710	7,3	648	258	7,5	48	15	93	94
30	8.483								
31	9.100								
MED	8.327	7,3	686	360	7,4	57	15	91	96
MIN	7.093	7,0	435	162	7,1	40	2	82	88
MAX	9.959	7,6	933	460	7,7	82	25	95	99
TOTAL	258.133	-	-	-	-	-	-	-	-

Rendimientos EDAR El Torno - Diciembre'15

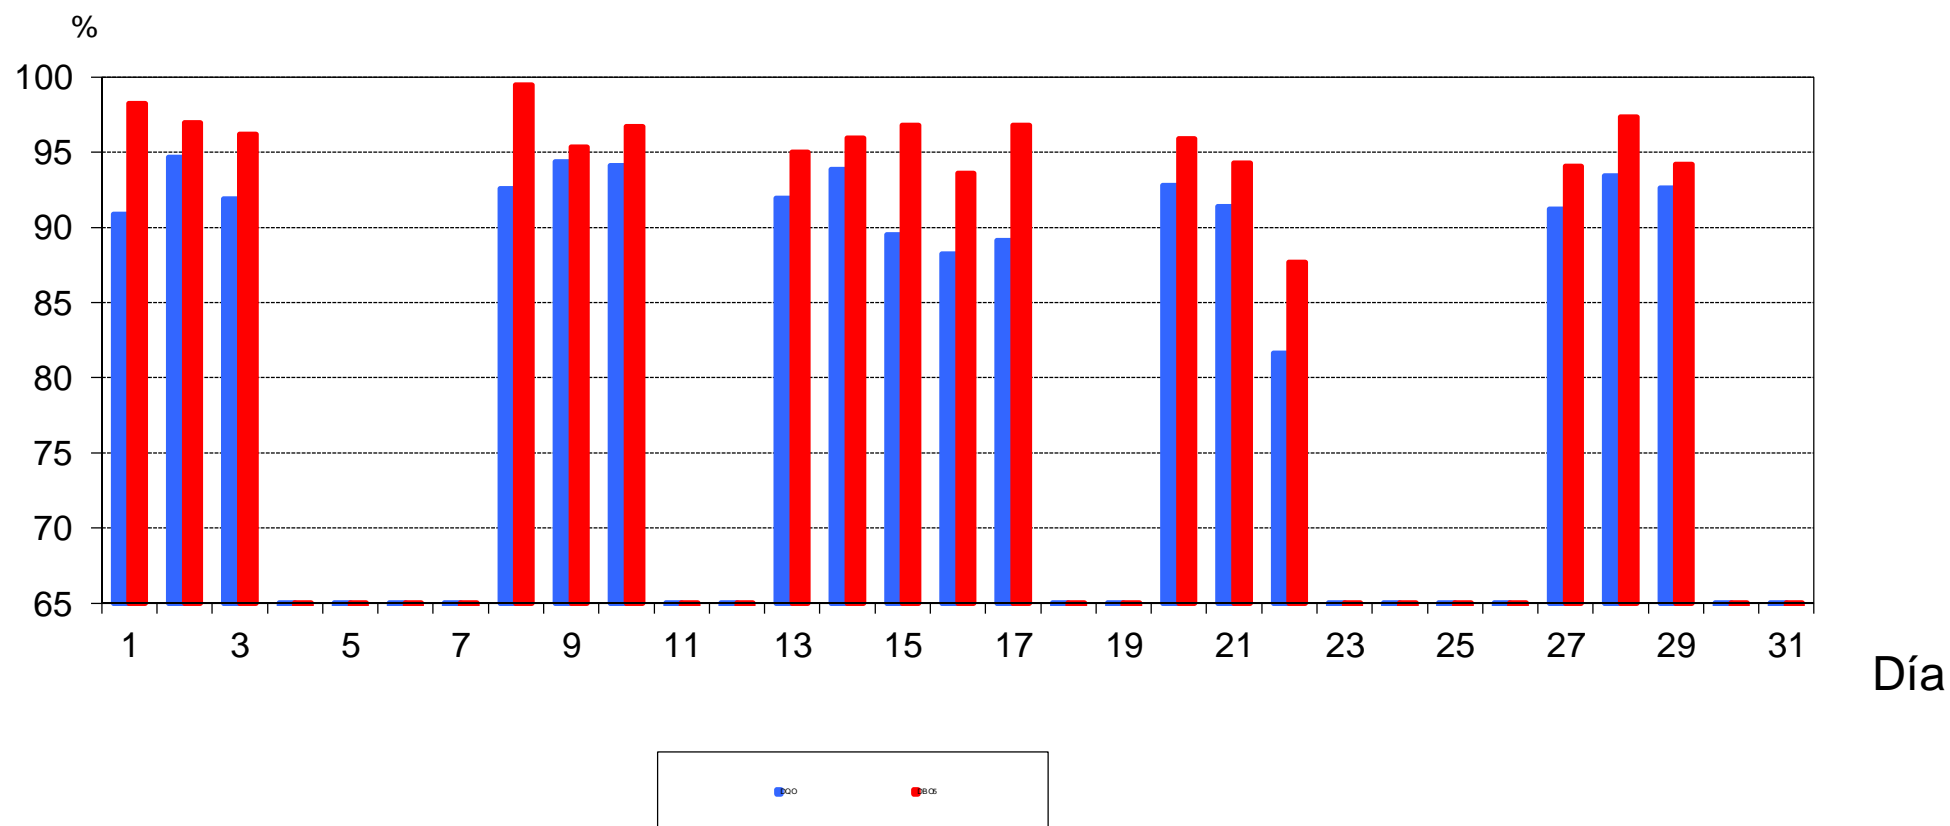

	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	2.975	7,9	364	106	7,1	23	3	94	97
2	2.968	7,6	320	147	6,9	25	4	92	97
3	2.766	7,5	332	79	6,9	25	2	93	97
4	3.073								
5	3.294								
6	3.590								
7	3.390								
8	3.317	7,6	354	240	7,6	25	3	93	99
9	3.159	7,2	342	120	7,4	25	8	93	93
10	3.138	7,4	259	102	6,8	25	3	90	97
11	2.981								
12	3.381								
13	4.720	7,4	404	120	7,5	32	9	92	92
14	2.834	7,4	250	120	7,3	27	10	89	92
15	2.784	7,6	310	103	7,3	23	2	93	98
16	2.743	7,4	283	93	7,9	27	1	91	99
17	2.724	7,6	266	75	7,7	21	2	92	97
18	2.911								
19	3.118								
20	3.036	7,4	257	180	7,2	51	14	80	92
21	3.233	7,4	630	300	7,3	28	2	95	99
22	3.322	7,6	274	71	6,8	26	2	90	97
23	2.964								
24	3.020								
25	2.908								
26	2.923								
27	3.146	7,2	450	220	7,1	22	2	95	99
28	3.926	7,6	578	260	6,8	27	4	95	98
29	3.983	7,5	600	190	7,7	26	5	96	97
30	3.210								
31	3.355								
MED	3.190	7,5	369	149	7,2	27	5	92	97
MIN	2.724	7,2	250	71	6,8	21	1	80	92
MAX	4.720	7,9	630	300	7,9	51	14	96	99
TOTAL	98.892	-	-	-	-	-	-	-	-

Rendimientos EDAR La Barrosa - Diciembre'15

