


	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	12.417								
2	10.229	7,2	852	360	7,2	96	20	89	94
3	11.747	6,7	910	529	7,4	101	12	89	98
4	11.527	6,9	952	571	7,4	104	32	89	94
5	10.887	7,1	918	536	7,1	103	18	89	97
6	11.797	7,1	910	450	7,1	109	22	88	95
7	11.427								
8	11.507								
9	11.976	7,2	918	440	7,1	121	16	87	96
10	10.919	7,1	877	360	7,1	103	26	88	93
11	14.417	7,1	877	313	7,2	96	11	89	96
12	11.137	7,1	902	343	7,2	108	14	88	96
13	12.487	7,0	902	429	7,1	109	18	88	96
14	11.607								
15	10.858								
16	10.278	7,2	960	340	7,2	108	23	89	93
17	10.871	7,1	902	360	7,3	103	26	89	93
18	10.918	7,3	960	350	7,0	113	24	88	93
19	11.152	7,1	943	571	7,3	108	21	89	96
20	10.675	7,2	645	245	7,4	104	28	84	89
21	11.024								
22	10.786								
23	10.202	7,2	621	260	7,5	109	15	82	94
24	11.102	7,0	819	380	7,1	114	16	86	96
25	10.800	7,3	927	350	7,6	98	17	89	95
26	10.620	7,1	918	514	7,1	113	30	88	94
27	9.986	7,3	1.705	621	7,3	113	15	93	98
28	9.590								
29	11.608								
30	10.393	7,1	877	320	7,0	101	11	88	97
31	10.841	6,7	902	440	7,3	109	20	88	95
MED	11.154	7,1	918	413	7,2	106	20	88	95
MIN	9.590	6,7	621	245	7,0	96	11	82	89
MAX	14.417	7,3	1.705	621	7,6	121	32	93	98
TOTAL	345.784	-	-	-	-	-	-	-	-

Rendimientos EDAR El Torno - Mayo'10

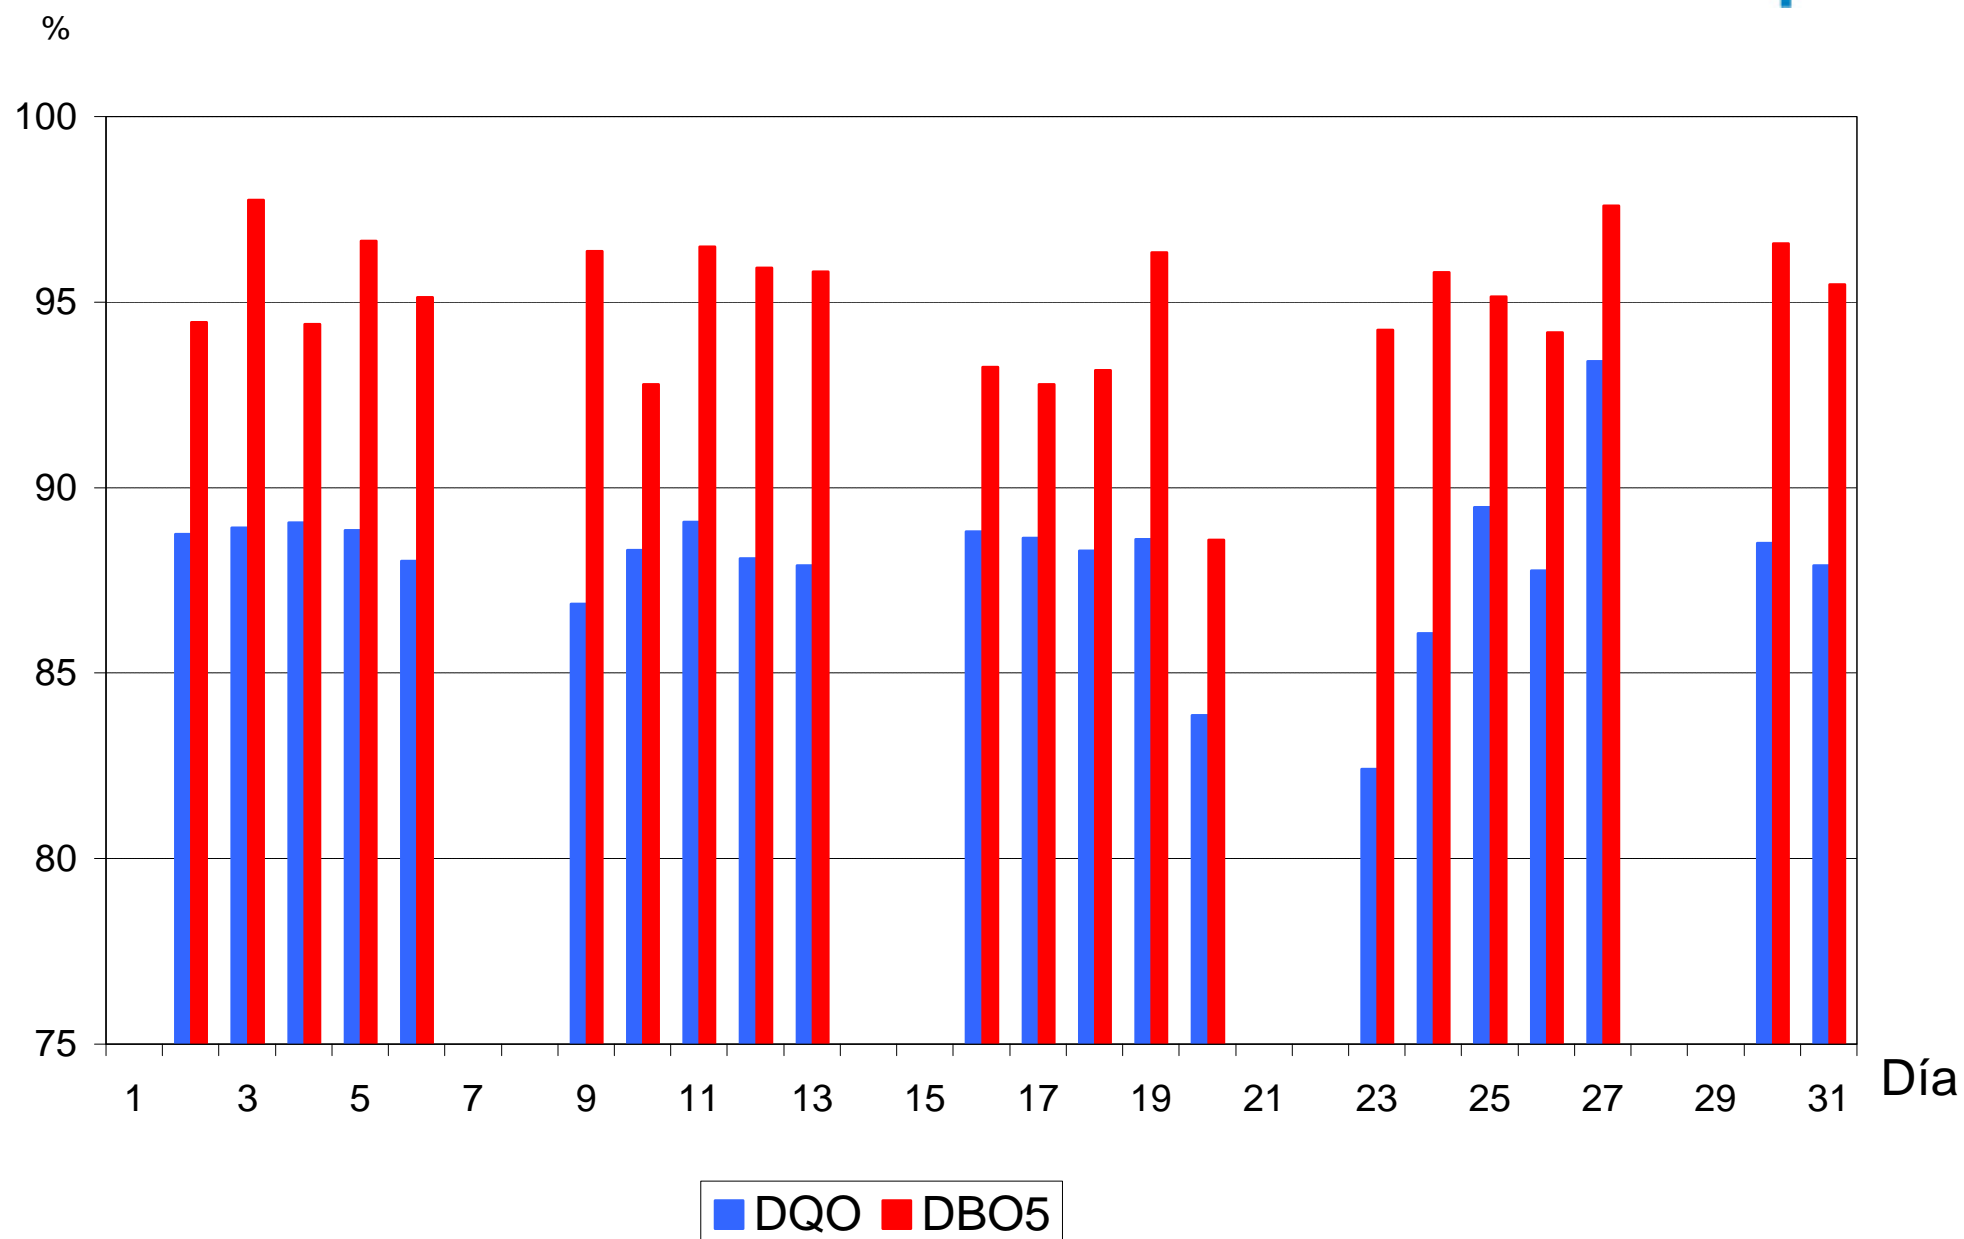

	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	7.362								
2	5.895	7,4	728	280	7,5	81	11	89	96
3	5.544	7,5	885	320	6,9	92	10	90	97
4	4.949	7,5	918	521	7,6	95	12	90	98
5	5.021	7,3	794	394	7,2	93	16	88	96
6	4.934	7,3	703	367	7,0	106	14	85	96
7	5.501								
8	6.031								
9	6.730	7,3	894	420	7,1	112	17	87	96
10	7.415	7,1	778	320	7,1	99	10	87	97
11	8.515	7,2	803	325	7,3	89	8	89	98
12	6.252	7,4	687	210	7,3	94	10	86	95
13	6.940	7,4	720	367	7,2	109	13	85	96
14	6.485								
15	7.196								
16	7.065	7,5	910	340	7,7	100	10	89	97
17	6.541	7,2	844	400	7,2	87	11	90	97
18	6.416	7,3	877	313	6,9	103	24	88	92
19	6.176	7,2	894	400	7,5	97	25	89	94
20	6.315	7,4	745	272	7,1	95	13	87	95
21	6.471								
22	6.900								
23	6.529	7,4	877	320	7,2	113	10	87	97
24	6.258	7,3	877	380	7,2	107	14	88	96
25	6.771	7,4	861	303	7,6	105	9	88	97
26	6.492	7,4	770	344	7,3	108	13	86	96
27	6.621	7,5	811	363	7,6	112	17	86	95
28	6.919								
29	8.912								
30	7.370	7,3	918	340	7,2	104	13	89	96
31	6.503	7,2	811	300	7,3	102	5	87	98
MED	6.549	7,3	823	345	7,3	100	13	88	96
MIN	4.934	7,1	687	210	6,9	81	5	85	92
MAX	8.912	7,5	918	521	7,7	113	25	90	98
TOTAL	203.029	-	-	-	-	-	-	-	-

Rendimientos EDAR La Barrosa - Mayo'10

