


	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	9.332	7,0	918	380	7,3	117	16	87	96
2	9.895	7,1	960	480	7,7	119	17	88	96
3	9.810	7,5	786	269	7,4	114	12	85	96
4	9.841	7,1	902	286	7,2	117	22	87	92
5	10.003	6,9	877	331	7,3	106	10	88	97
6	10.366								
7	9.135								
8	8.791	7,2	927	440	7,5	111	15	88	97
9	9.369	7,0	1.010	460	7,4	114	6	89	99
10	9.690	6,9	985	400	7,4	117	7	88	98
11	10.058	7,0	1.092	367	7,4	109	12	90	97
12	10.249	6,8	952	429	6,9	117	13	88	97
13	10.664								
14	9.306								
15	8.956								
16	9.803	7,5	531	320	7,3	91	15	83	95
17	9.787	7,2	750	440	7,4	47	7	94	98
18	9.593	7,4	546	207	7,4	104	15	81	93
19	9.452	7,1	1.043	425	7,4	116	10	89	98
20	9.784								
21	8.530								
22	8.493	7,0	902	400	7,4	104	12	88	97
23	9.011	7,0	918	400	7,6	119	14	87	97
24	9.543	7,3	885	369	7,2	114	15	87	96
25	8.868	7,2	869	381	7,2	119	22	86	94
26	9.807	7,2	943	300	7,2	114	12	88	96
27	9.012								
28	9.052								
29	8.570	7,0	910	360	7,5	111	9	88	98
30	9.289	7,0	1.043	440	7,3	116	19	89	96
31	9.370	7,3	753	272	7,4	114	26	85	90
MED	9.465	7,1	886	371	7,4	110	14	87	96
MIN	8.493	6,8	531	207	6,9	47	6	81	90
MAX	10.664	7,5	1.092	480	7,7	119	26	94	99
TOTAL	293.429	-	-	-	-	-	-	-	-

Rendimientos EDAR El Torno - Agosto'10

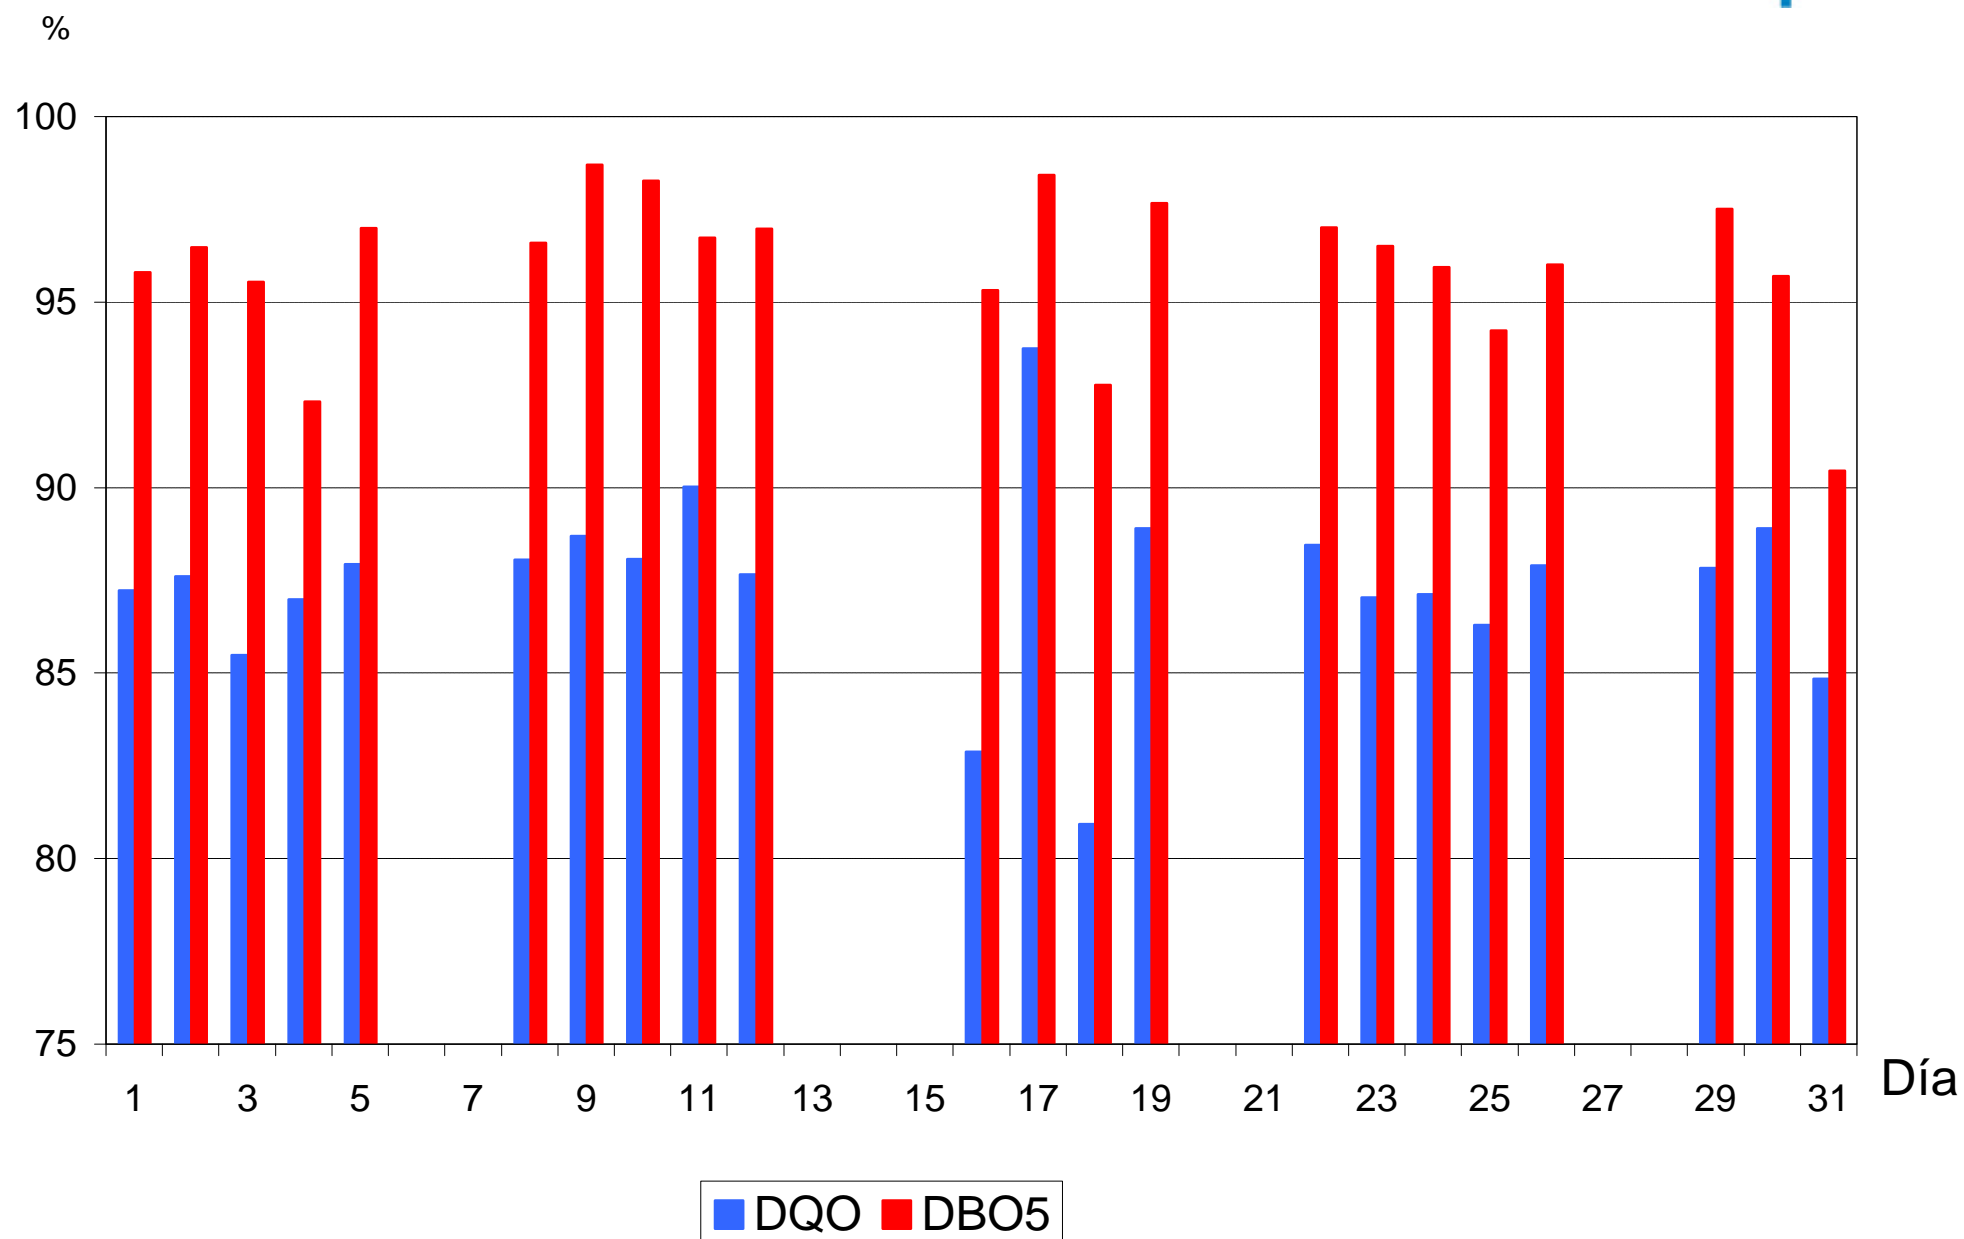

**E.D.A.R. La Barrosa****Agosto'10**

	Caudal entrada	AGUA BRUTA				AGUA TRATADA			REND. ELIMINACION	
		pH		D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-		mg/l	mg/l	-	mg/l	mg/l	%	%
1	9.848	7,1	1.691,0	943	500	7,2	114	14	88	97
2	10.440	7,4	1.817,0	827	380	7,4	105	13	87	97
3	10.357	7,4	1.883,0	794	381	7,3	106	8	87	98
4	11.108	6,9	2.950,0	960	357	7,1	112	12	88	97
5	11.283	7,2	2.130,0	1.010	536	7,1	108	12	89	98
6	11.038									
7	11.469									
8	11.414	7,3	1.894,0	968	460	7,3	100	14	90	97
9	10.638	7,2	1.804,0	1.001	420	7,2	112	12	89	97
10	11.226	7,1	2.990,0	935	443	7,5	107	19	89	96
11	11.468	7,0	5.660,0	803	350	7,1	109	10	86	97
12	12.140	6,9	8.550,0	728	322	6,9	112	9	85	97
13	11.406									
14	11.387									
15	10.922									
16	10.623	6,9	1.895,0	737	460	7,2	99	9	87	98
17	10.814	7,2	1.632,0	657	340	7,2	58	7	91	98
18	10.422	7,0	1.593,0	811	400	7,2	111	17	86	96
19	10.759	7,2	1.631,0	935	386	7,2	117	14	87	96
20	11.096									
21	10.930									
22	11.225	7,2	1.843,0	902	420	7,2	110	15	88	97
23	11.360	7,0	1.786,0	976	480	7,2	114	11	88	98
24	10.757	7,1	1.758,0	1.043	550	7,2	117	24	89	96
25	10.000	7,2	2.170,0	1.026	433	7,2	115	13	89	97
26	10.840	7,1	2.190,0	1.001	429	7,1	111	10	89	98
27	10.514									
28	10.553									
29	10.224	7,3	2.070,0	952	340	7,4	113	14	88	96
30	9.194	7,1	1.796,0	902	380	7,1	116	12	87	97
31	7.945	7,3	1.794,0	902	436	7,2	117	13	87	97
MED	10.755	7,1	2.433,0	901	418	7,2	108	13	88	97
MIN	7.945	6,9	1.593,0	657	322	6,9	58	7	85	96
MAX	12.140	7,4	8.550,0	1.043	550	7,5	117	24	91	98
TOTAL	333.400	-		-	-	-	-	-	-	-

Rendimientos EDAR La Barrosa - Agosto'10

