


	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	13.308	7,1	1.092	460	7,3	93	8	91	98
2	11.256	7,3	703	340	7,5	108	11	85	97
3	11.257	7,2	1.043	393	7,4	99	15	90	96
4	13.033	7,5	885	356	7,4	81	13	91	96
5	12.419								
6	14.179								
7	10.854								
8	14.278								
9	16.380	7,2	778	320	7,2	94	12	88	96
10	13.276	7,5	960	340	7,3	86	5	91	99
11	14.506	7,5	761	283	7,4	106	13	86	95
12	15.879								
13	12.619								
14	11.970	7,5	869	340	7,4	84	8	90	98
15	11.930	7,5	1.051	436	7,4	103	23	90	95
16	12.710	7,5	885	338	7,2	122	14	86	96
17	12.365	7,3	885	338	7,4	109	14	88	96
18	11.298	7,4	902	407	7,4	109	21	88	95
19	12.474								
20	11.062								
21	10.712	7,5	935	540	7,3	106	12	89	98
22	11.527	7,3	819	360	7,3	89	10	89	97
23	11.212	7,3	993	371	7,4	124	8	88	98
24	11.121	7,3	1.109	467	7,5	114	20	90	96
25	13.728	7,6	877	408	7,5	104	16	88	96
26	11.935								
27	11.672								
28	11.963	7,3	1.001	420	7,3	117	13	88	97
29	13.008	7,1	869	420	7,4	116	7	87	98
30	14.490	7,2	1.001	590	7,3	117	14	88	98
31	14.037								
MED	12.660	7,4	921	396	7,4	104	13	89	97
MIN	10.712	7,1	703	283	7,2	81	5	85	95
MAX	16.380	7,6	1.109	590	7,5	124	23	91	99
TOTAL	392.460	-	-	-	-	-	-	-	-

# Rendimientos EDAR El Torno - Marzo'10

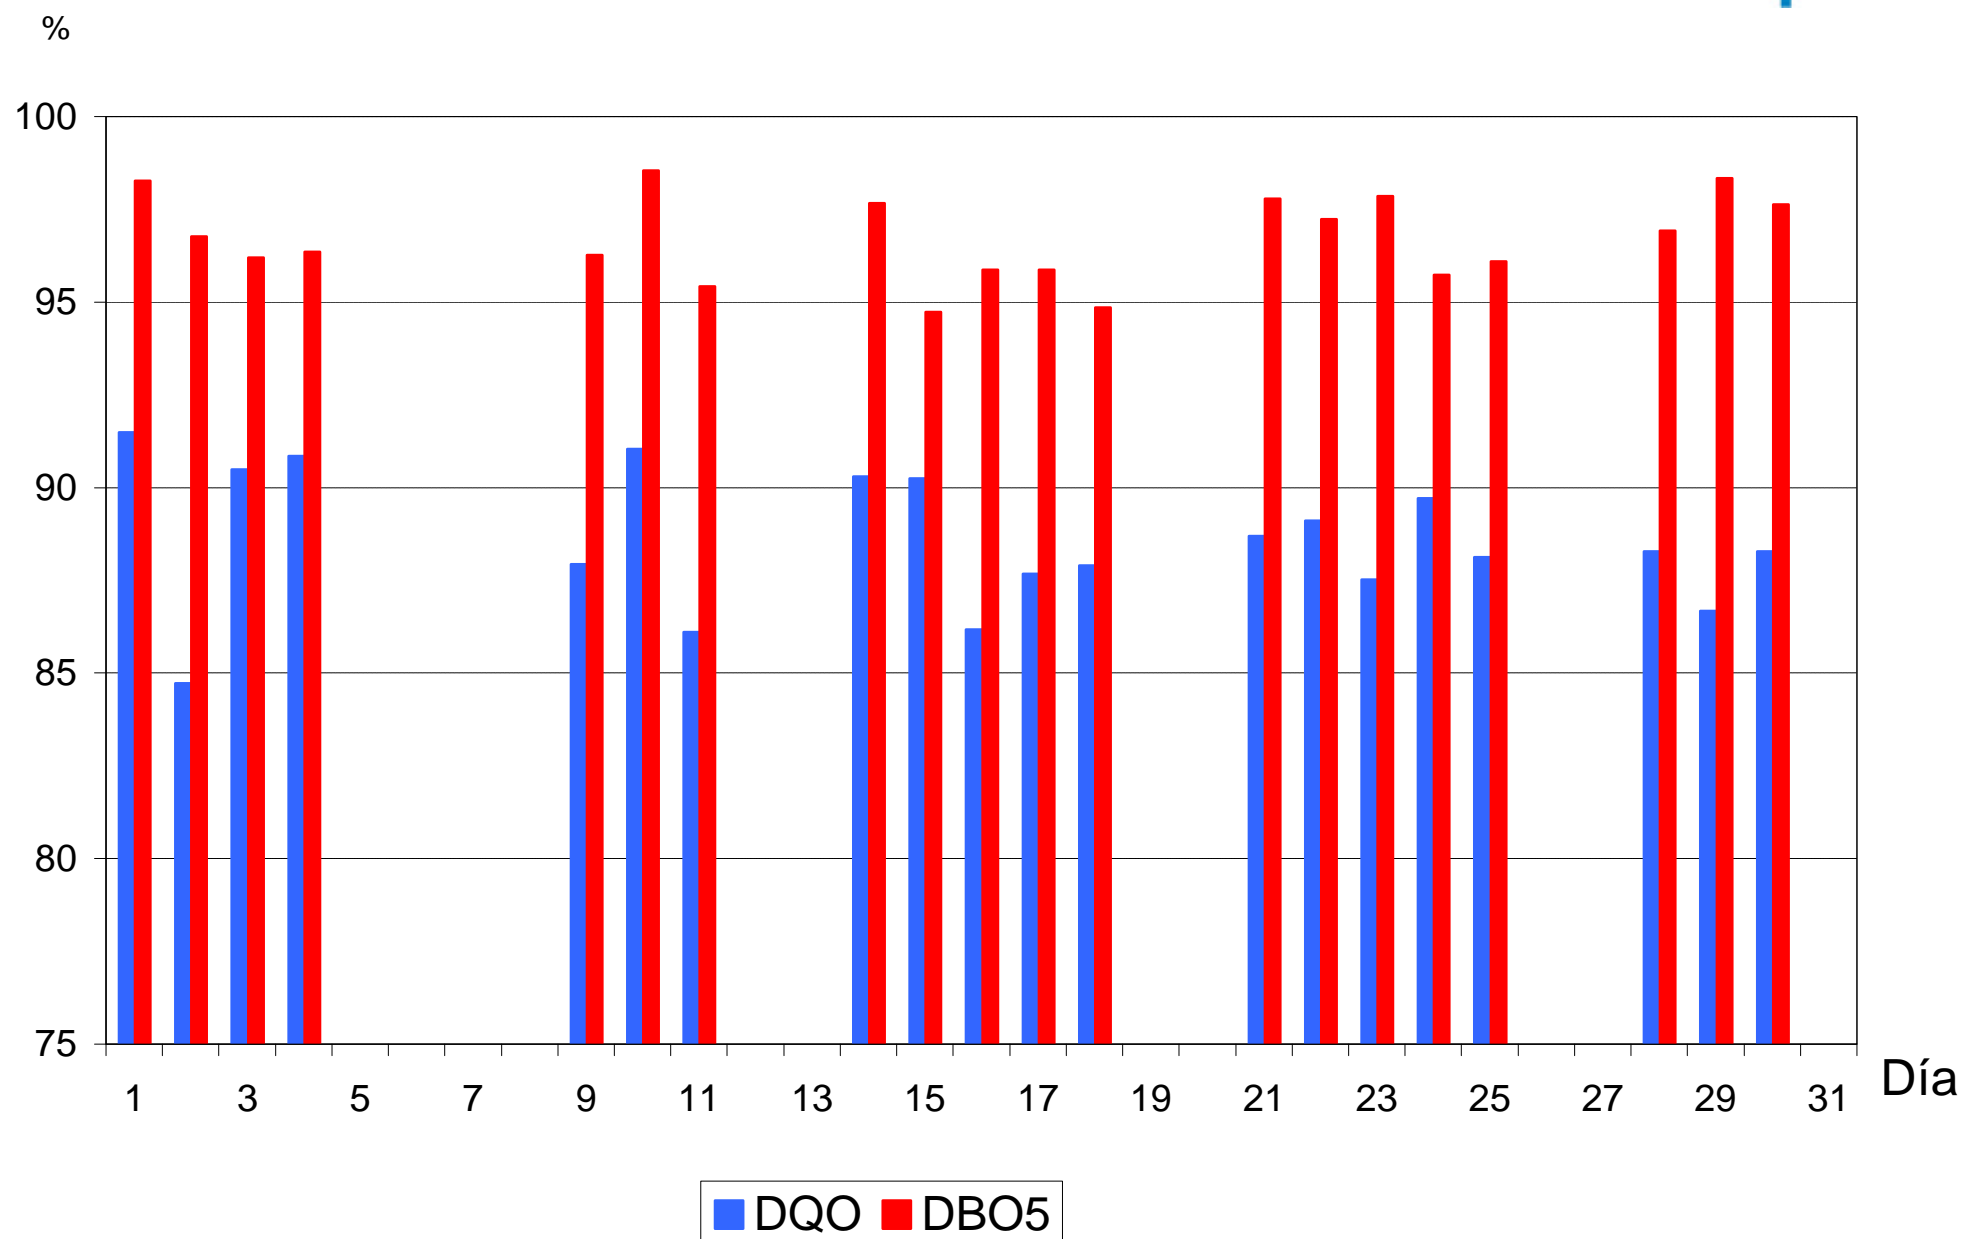

	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	7.923	7,3	761	320	7,1	83	7	89	98
2	11.026	7,2	538	320	7,1	91	7	83	98
3	10.273	7,5	885	379	7,3	92	13	90	97
4	11.159	7,5	811	225	7,3	87	8	89	97
5	8.496								
6	4.200								
7	0								
8	0								
9	0								
10	4.869	7,3	852	300	7,1	81	10	90	97
11	7.321	7,2	587	205	7,2	108	16	82	92
12	6.373								
13	4.903								
14	4.025	7,3	836	340	7,0	73	15	91	96
15	4.318	7,3	670	240	7,2	76	5	89	98
16	3.645	7,3	753	306	7,3	91	8	88	97
17	4.186	7,3	827	338	7,2	76	10	91	97
18	6.589	7,2	778	317	7,1	113	17	86	95
19	7.668								
20	7.859								
21	7.833	7,5	918	400	7,2	91	10	90	98
22	6.416	7,3	778	360	7,2	77	9	90	98
23	6.471	7,5	918	336	7,2	105	6	89	98
24	6.391	7,4	869	306	7,2	91	14	89	95
25	7.177	7,7	852	471	7,3	96	9	89	98
26	7.543								
27	7.688								
28	8.704	7,3	877	340	7,2	98	6	89	98
29	8.015	7,3	819	360	7,2	94	10	89	97
30	8.166	7,4	869	371	7,8	89	6	90	98
31	6.279								
MED	6.307	7,4	800	328	7,2	90	10	89	97
MIN	0	7,2	538	205	7,0	73	5	82	92
MAX	11.159	7,7	918	471	7,8	113	17	91	98
TOTAL	195.515	-	-	-	-	-	-	-	-

# Rendimientos EDAR La Barrosa - Marzo'10

