


	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	13.781								
2	11.200								
3	9.846	7,0	869	400	7,2	93	8	89	98
4	10.215								
5	11.841								
6	9.944	7,3	902	380	7,2	127	5	86	99
7	11.613	7,1	885	317	7,1	79	9	91	97
8	12.448								
9	11.219								
10	9.520	7,3	778	300	7,3	101	8	87	97
11	11.041	7,3	794	320	7,2	104	21	87	93
12	10.869	7,2	836	369	7,2	121	8	86	98
13	12.442	7,2	811	356	7,2	101	18	88	95
14	12.614	7,4	753	322	7,3	117	6	84	98
15	12.443								
16	11.845								
17	10.582	7,4	894	360	7,3	93	8	90	98
18	11.169	7,3	952	380	7,1	109	6	89	98
19	11.408	7,1	861	367	7,2	99	7	88	98
20	11.179	7,3	910	410	7,2	81	15	91	96
21	10.529	7,4	645	265	7,4	101	13	84	95
22	11.491								
23	10.921								
24	11.836	7,2	985	660	7,2	108	11	89	98
25	12.373	7,2	794	320	7,0	98	19	88	94
26	10.722	7,3	745	389	7,2	109	7	85	98
27	13.758	7,3	861	369	7,3	121	14	86	96
28	12.263	7,2	869	344	7,1	116	12	87	97
29	13.690								
30	11.311								
31	11.119	7,1	827	400	7,2	83	11	90	97
MED	11.524	7,2	841	370	7,2	103	11	88	97
MIN	9.520	7,0	645	265	7,0	79	5	84	93
MAX	13.781	7,4	985	660	7,4	127	21	91	99
TOTAL	357.234	-	-	-	-	-	-	-	-

Rendimientos EDAR El Torno - Enero'10

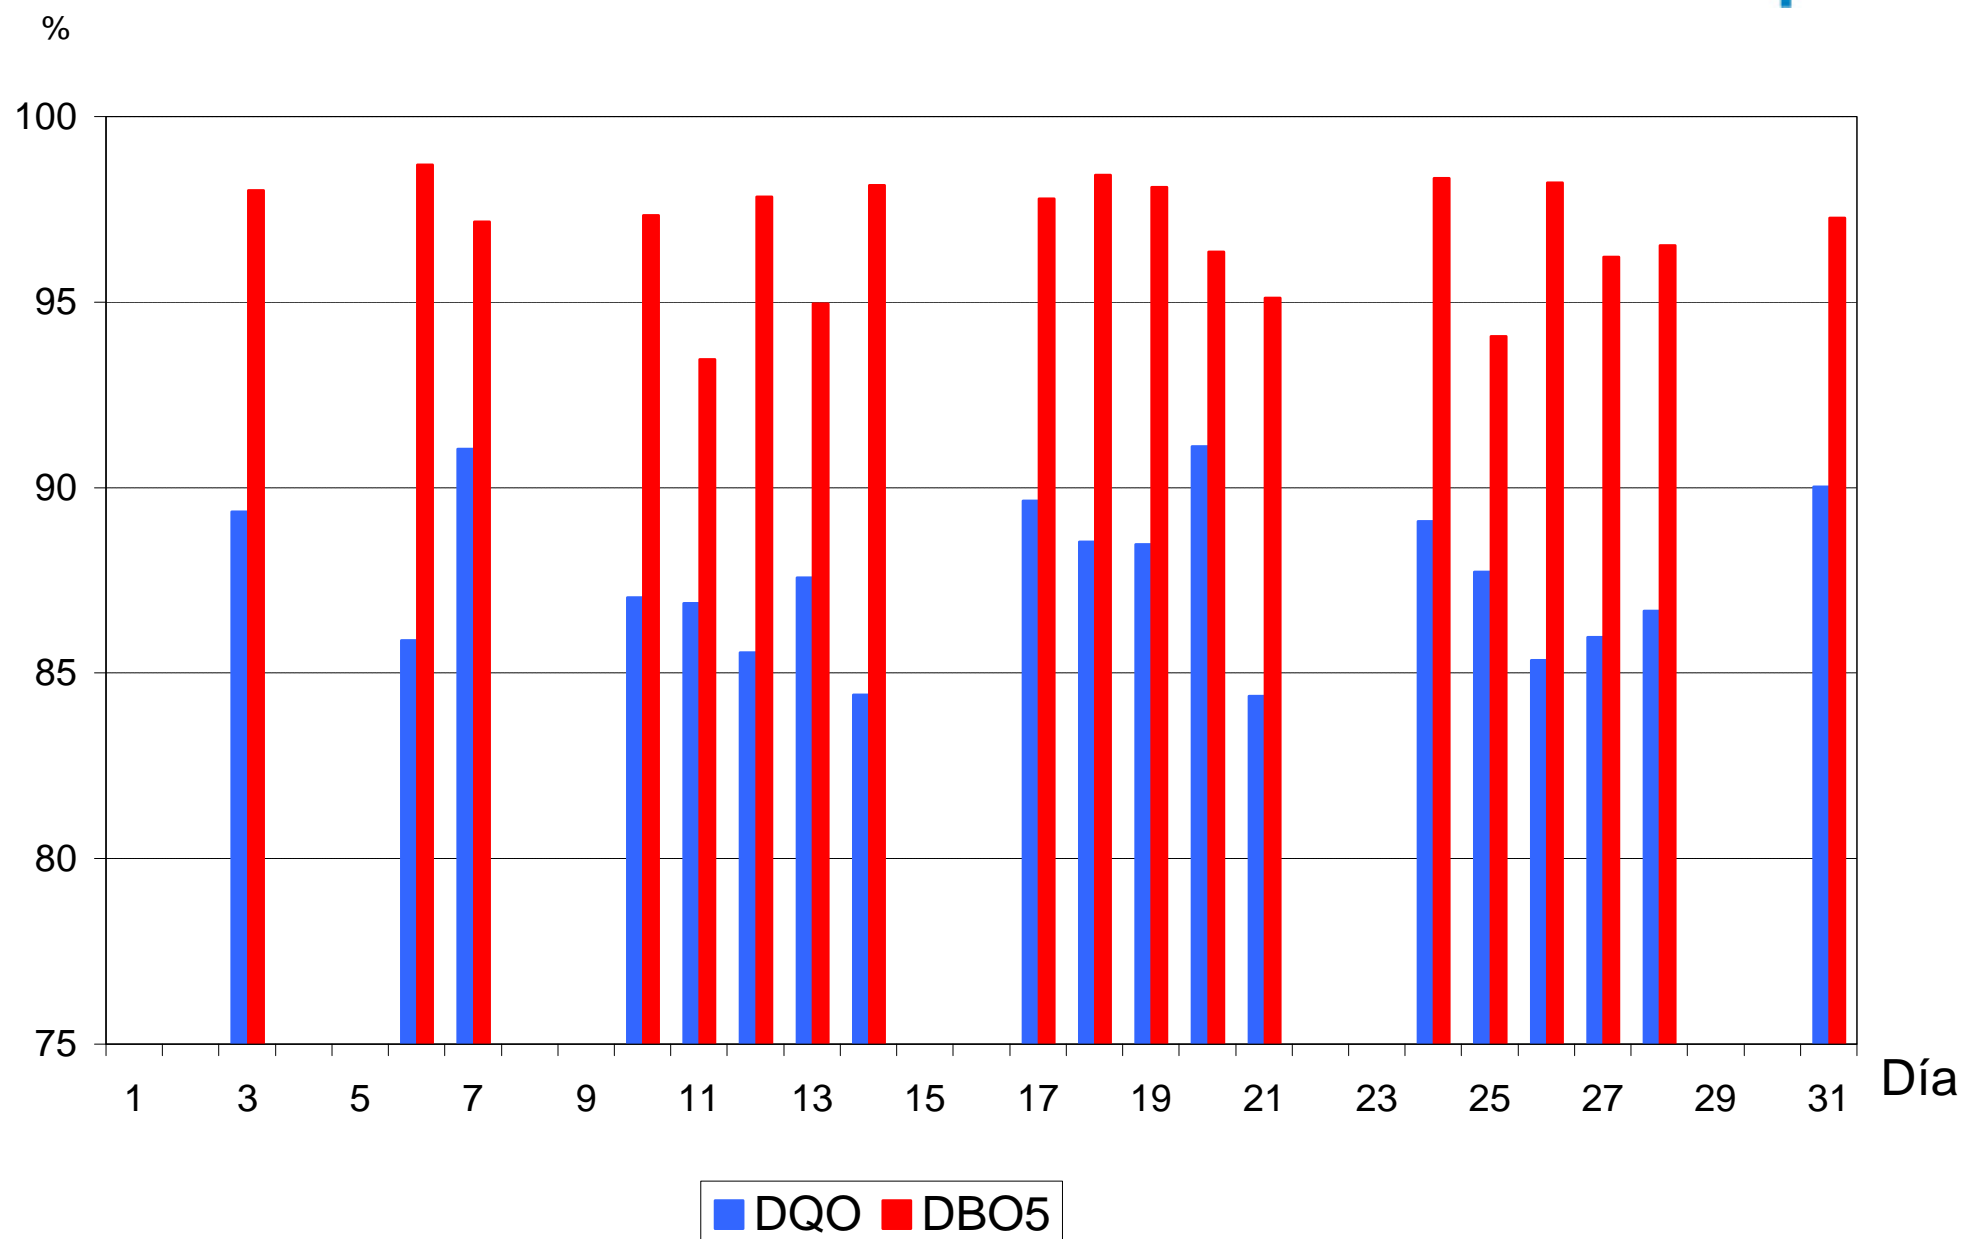

	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	7.385								
2	5.743								
3	6.457	7,2	786	320	6,8	93	14	88	96
4	8.944								
5	12.100								
6	12.901	7,1	827	420	7,1	107	9	87	98
7	10.778	7,3	968	407	7,1	96	8	90	98
8	9.188								
9	7.717								
10	11.489	7,4	662	280	7,2	85	18	87	94
11	10.802	7,3	786	360	7,4	77	6	90	98
12	12.201	7,3	861	350	7,3	101	6	88	98
13	10.707	7,3	720	350	7,3	96	10	87	97
14	6.043	7,4	894	379	7,1	106	12	88	97
15	10.217								
16	7.002								
17	6.903	7,5	819	320	7,4	102	5	87	99
18	6.696	7,4	794	360	7,5	105	7	87	98
19	6.402	7,3	811	338	7,4	89	6	89	98
20	6.236	7,3	844	364	7,1	101	10	88	97
21	6.155	7,4	654	300	7,2	90	13	86	96
22	6.009								
23	13.464								
24	11.260	7,4	836	340	7,3	79	9	91	97
25	8.070	7,3	811	380	7,0	100	11	88	97
26	12.527	7,4	753	339	7,2	94	9	88	97
27	11.026	7,3	902	364	7,1	116	12	87	97
28	9.716	7,5	604	214	7,2	91	16	85	93
29	7.425								
30	7.385								
31	6.940	7,2	935	340	7,1	89	8	90	98
MED	8.900	7,3	803	343	7,2	96	10	88	97
MIN	5.743	7,1	604	214	6,8	77	5	85	93
MAX	13.464	7,5	968	420	7,5	116	18	91	99
TOTAL	275.888	-	-	-	-	-	-	-	-

Rendimientos EDAR La Barrosa - Enero'10

