


	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	11.923	6,4	1.307	640	7,1	141	16	89	98
2	11.559	7,4	1.150	820	7,3	177	8	85	99
3	11.911	7,2	902	393	7,3	89	15	90	96
4	13.368	7,1	885	344	7,3	116	17	87	95
5	11.465								
6	10.988								
7	10.609	7,4	811	360	7,2	106	7	87	98
8	13.267	7,5	654	280	7,2	108	18	84	94
9	12.999	7,3	761	344	7,3	108	16	86	95
10	10.949	7,2	463	200	7,4	106	23	77	89
11	10.879	7,2	621	223	7,4	81	19	87	91
12	10.788								
13	13.275								
14	12.938	7,2	952	360	7,4	109	21	89	94
15	13.383	7,2	952	360	7,1	101	17	89	95
16	11.761	7,2	885	325	7,5	99	9	89	97
17	13.696	7,2	894	408	7,5	117	25	87	94
18	11.989	7,6	596	227	7,5	81	18	86	92
19	14.752								
20	12.553								
21	12.706	7,2	621	260	7,4	96	6	85	98
22	17.903	7,5	877	340	7,6	88	13	90	96
23	13.213	7,4	927	321	7,3	98	8	89	98
24	14.675	7,5	662	260	7,3	108	11	84	96
25	12.931	7,6	902	471	7,5	101	16	89	97
26	10.200								
27	12.463								
28	12.903								
MED	12.573	7,3	833	365	7,3	107	15	87	95
MIN	10.200	6,4	463	200	7,1	81	6	77	89
MAX	17.903	7,6	1.307	820	7,6	177	25	90	99
TOTAL	352.050	-	-	-	-	-	-	-	-

Rendimientos EDAR El Torno - Febrero'10



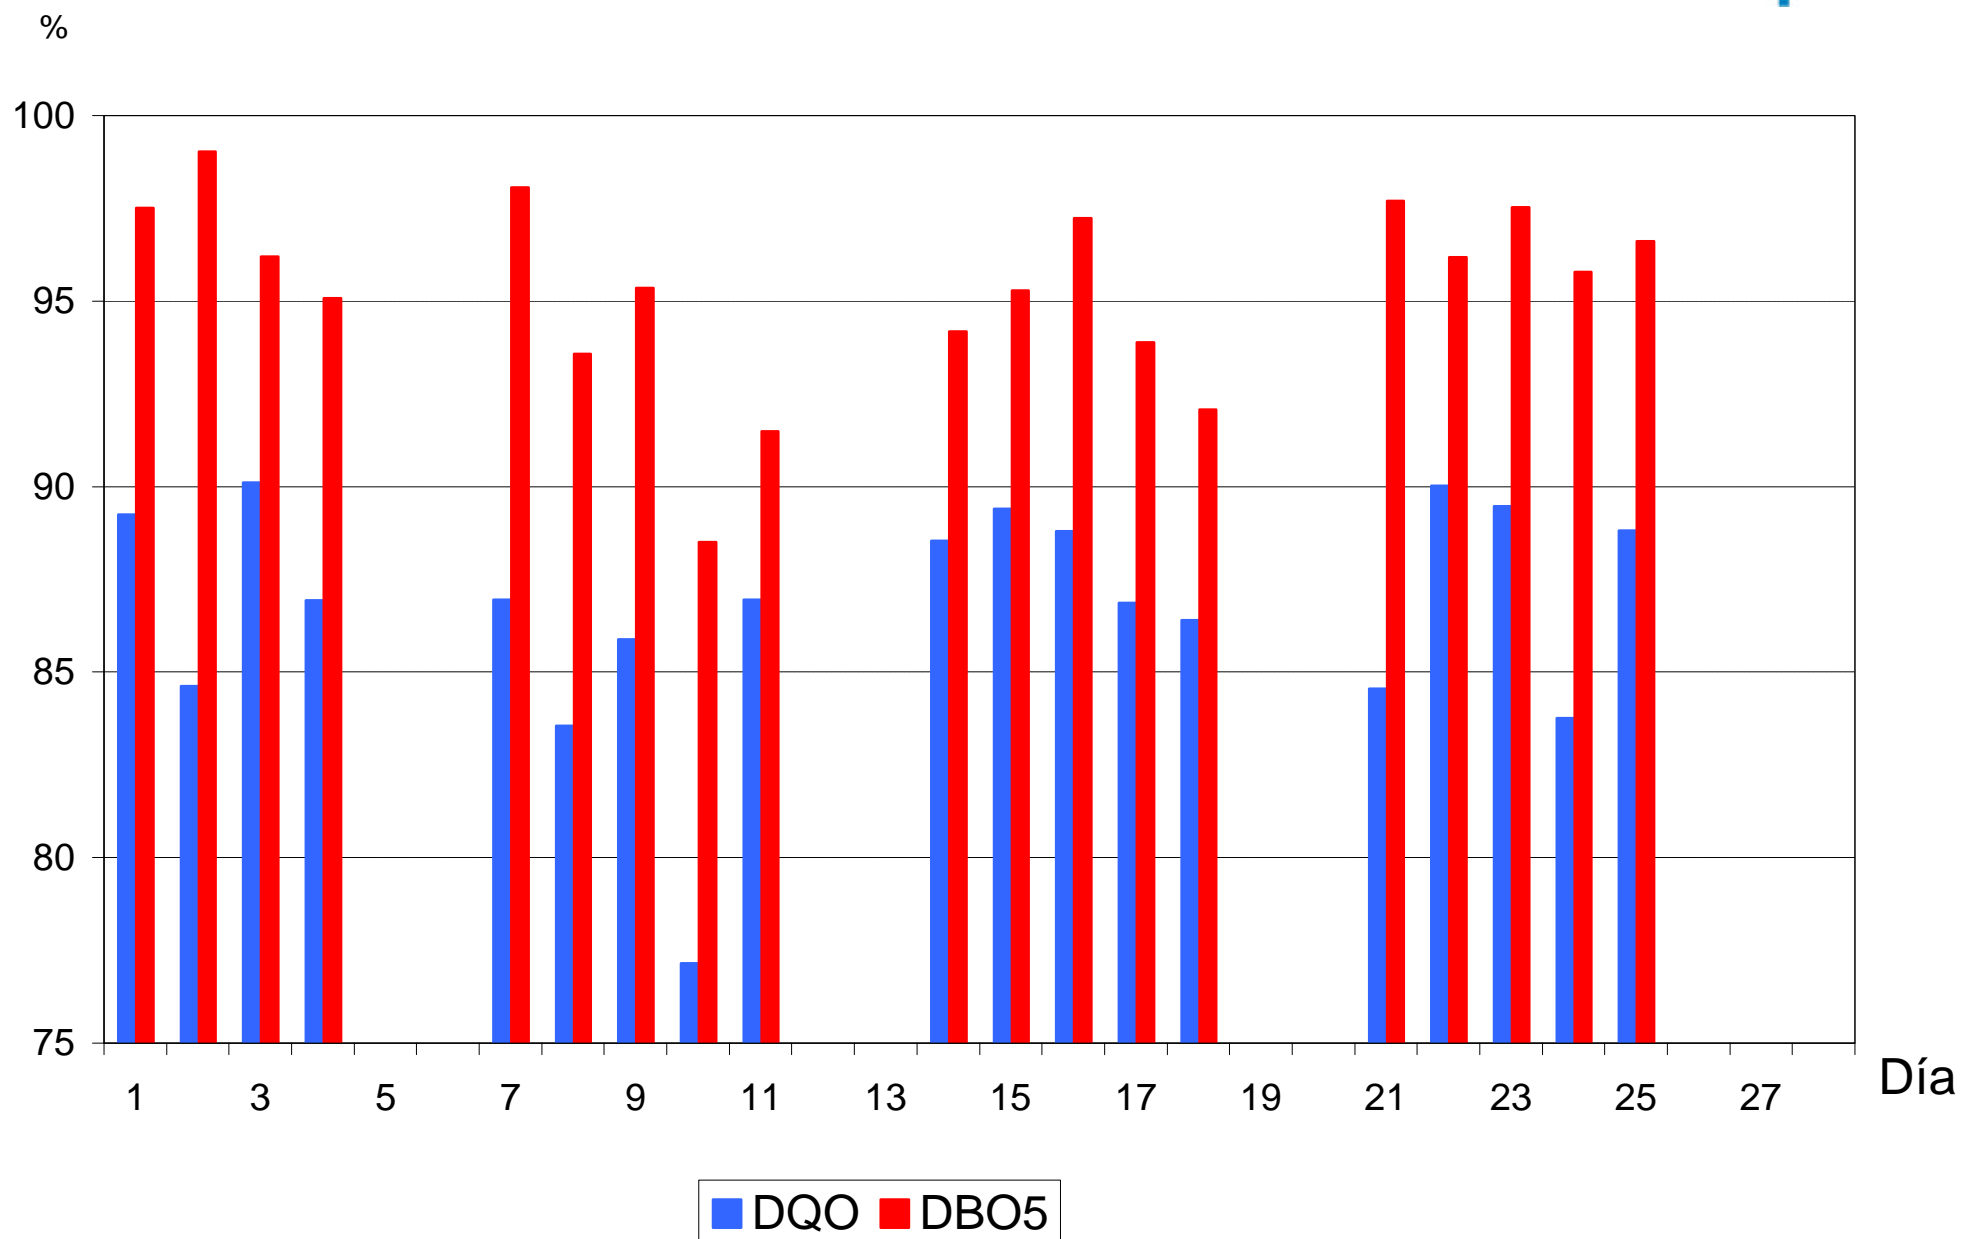

E.D.A.R. La Barrosa

Febrero'10

	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	6.413	7,2	496	142	7,1	95	8	81	94
2	6.231	7,5	753	360	7,4	100	10	87	97
3	8.924	7,3	513	250	7,1	101	10	80	96
4	9.697	7,5	869	342	7,1	109	9	87	97
5	8.010								
6	6.568								
7	6.978	7,2	861	340	7,0	97	5	89	98
8	12.206	7,2	505	260	7,1	74	8	85	97
9	8.589	7,4	554	250	7,6	80	7	85	97
10	10.969	7,3	447	190	7,3	83	15	81	92
11	8.061	7,2	803	331	7,1	76	7	91	98
12	12.090								
13	9.729								
14	7.068	7,1	811	320	7,2	88	10	89	97
15	14.365	7,4	529	260	7,3	89	11	83	96
16	12.130	7,4	612	236	7,1	93	9	85	96
17	10.490	7,3	794	369	7,1	89	18	89	95
18	11.999	7,2	414	134	7,1	60	7	85	95
19	11.512								
20	10.867								
21	12.346	7,5	587	240	7,1	97	12	84	95
22	12.093	7,2	819	320	7,2	90	10	89	97
23	8.936	7,2	645	235	7,1	87	5	86	98
24	7.329	7,4	935	508	7,2	90	15	90	97
25	8.536	7,3	869	363	7,2	77	6	91	98
26	8.277								
27	7.551								
28	8.719								
MED	9.524	7,3	675	287	7,2	88	10	86	96
MIN	6.231	7,1	414	134	7,0	60	5	80	92
MAX	14.365	7,5	935	508	7,6	109	18	91	98
TOTAL	266.683	-	-	-	-	-	-	-	-

Rendimientos EDAR La Barrosa - Febrero'10

