


	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	10.121	7,1	927	421	7,2	116	27	88	94
2	9.520	7,1	885	306	7,3	121	11	86	96
3	9.689								
4	9.449								
5	8.884	7,1	736	380	7,2	116	12	84	97
6	9.275	6,9	1.043	460	7,2	117	11	89	98
7	10.029								
8	9.969	6,9	902	400	7,3	119	16	87	96
9	10.148	7,0	960	343	7,4	106	14	89	96
10	10.035								
11	10.034								
12	8.887	7,0	902	340	7,3	117	21	87	94
13	9.561	7,2	629	320	7,4	81	21	87	93
14	9.462	7,0	629	291	7,4	73	5	88	98
15	9.718	7,0	894	464	7,3	114	15	87	97
16	9.061	7,1	786	338	7,2	108	12	86	96
17	9.814								
18	10.035								
19	8.168	7,0	811	340	7,3	116	22	86	94
20	8.213	7,2	819	440	7,3	101	8	88	98
21	8.345	7,0	960	521	7,4	109	30	89	94
22	8.903	7,2	869	325	7,2	113	12	87	96
23	8.867	7,1	778	372	7,1	116	33	85	91
24	9.259								
25	9.521								
26	8.426	7,1	844	320	7,3	98	8	88	98
27	8.901	7,3	778	360	7,2	113	15	86	96
28	8.739	7,4	687	315	7,3	113	17	84	95
29	8.797	7,4	687	338	7,3	113	15	84	96
30	8.552	7,3	852	331	7,4	119	14	86	96
MED	9.279	7,1	827	368	7,3	109	16	87	96
MIN	8.168	6,9	629	291	7,1	73	5	84	91
MAX	10.148	7,4	1.043	521	7,4	121	33	89	98
TOTAL	278.382	-	-	-	-	-	-	-	-

Rendimientos EDAR El Torno - Septiembre'10

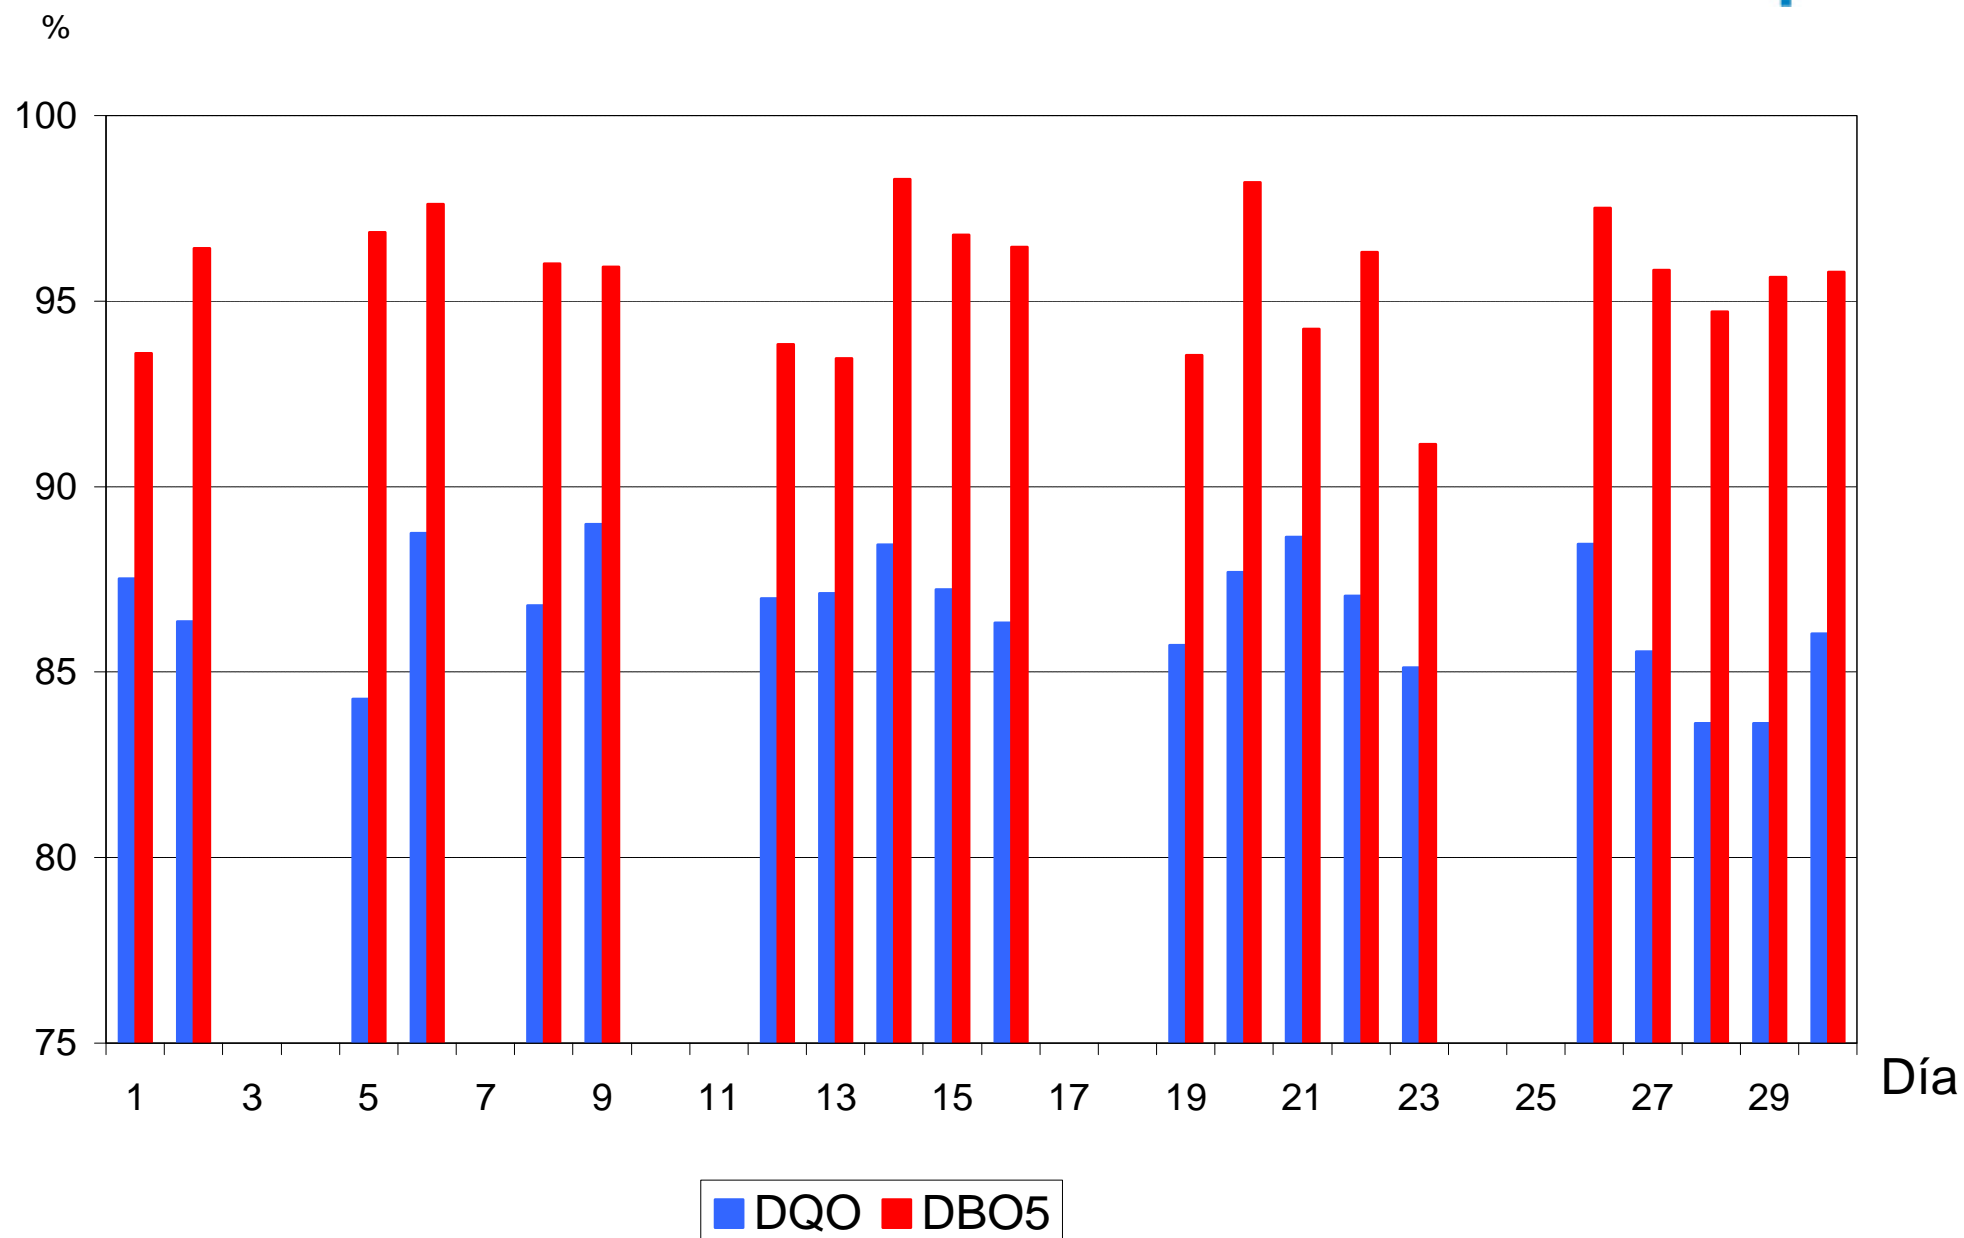

	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	8.204	7,2	869	331	7,3	117	11	87	97
2	8.231	7,4	786	263	7,5	117	15	85	94
3	8.712								
4	8.984								
5	8.628	7,0	794	320	7,2	117	14	85	96
6	8.179	7,3	728	380	7,1	117	8	84	98
7	8.476								
8	7.870	7,0	836	313	7,4	103	10	88	97
9	7.877	7,2	943	443	7,3	112	11	88	98
10	8.013								
11	8.498								
12	7.978	7,2	952	420	7,2	115	16	88	96
13	7.121	7,5	852	440	7,3	76	12	91	97
14	6.785	7,2	637	300	7,5	76	6	88	98
15	6.990	7,5	753	333	7,3	99	13	87	96
16	7.241	6,9	770	283	7,4	103	12	87	96
17	5.317								
18	7.719								
19	7.396	7,2	844	400	7,2	104	19	88	95
20	6.420	7,3	794	380	7,3	106	7	87	98
21	6.580	7,2	985	586	7,5	107	19	89	97
22	6.528	7,3	869	463	7,4	104	13	88	97
23	6.171	7,2	861	363	7,4	105	8	88	98
24	6.896								
25	6.935								
26	6.747	7,1	869	300	7,4	105	8	88	97
27	6.361	7,2	1.018	460	7,5	107	8	90	98
28	6.753	7,4	770	372	7,6	113	15	85	96
29	5.868	7,4	770	364	7,5	114	10	85	97
30	6.222	7,3	836	350	7,4	113	12	86	97
MED	7.323	7,2	835	375	7,4	106	12	87	97
MIN	5.317	6,9	637	263	7,1	76	6	84	94
MAX	8.984	7,5	1.018	586	7,6	117	19	91	98
TOTAL	219.700	-	-	-	-	-	-	-	-

Rendimientos EDAR La Barrosa - Septiembre'10

