


	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	8.840	7,3	830	531	7,3	84	20	90	96
2	9.871								
3	8.743								
4	8.231	7,2	1.254	220	6,9	89	5	93	98
5	8.812								
6	8.702	7,5	1.098	246	7,5	130	11	88	96
7	8.835								
8	8.550	7,2	1.046	483	7,1	114	26	89	95
9	9.088								
10	8.558								
11	10.550	7,5	1.127	560	7,6	86	17	92	97
12	9.294	7,4	763	340	7,2	87	11	89	97
13	9.415	7,3	734	183	7,1	89	10	88	95
14	9.067	7,3	704	278	7,3	86	13	88	95
15	10.104	7,4	674	200	7,5	99	9	85	96
16	11.182								
17	8.918								
18	8.599	7,3	600	320	7,5	102	19	83	94
19	9.352	7,4	1.239	360	7,5	113	2	91	99
20	9.768	7,3	1.083	417	7,3	117	26	89	94
21	8.586	7,4	875	417	7,3	115	25	87	94
22	9.833	7,3	1.068	480	7,4	104	12	90	98
23	9.889								
24	9.287								
25	9.372								
26	8.484	7,2	986	460	7,4	155	32	84	93
27	9.076	7,3	912	436	7,5	173	30	81	93
28	9.229	7,5	815	294	7,4	145	33	82	89
29	8.720	7,4	763	283	7,5	180	43	76	85
30	9.359				7,3	136			
31	9.061				7,3	136			
MED	9.206	7,3	921	362	7,3	117	19	87	95
MIN	8.231	7,2	600	183	6,9	84	2	76	85
MAX	11.182	7,5	1.254	560	7,6	180	43	93	99
TOTAL	285.375	-	-	-	-	-	-	-	-

## Rendimientos EDAR El Torno - Diciembre'11

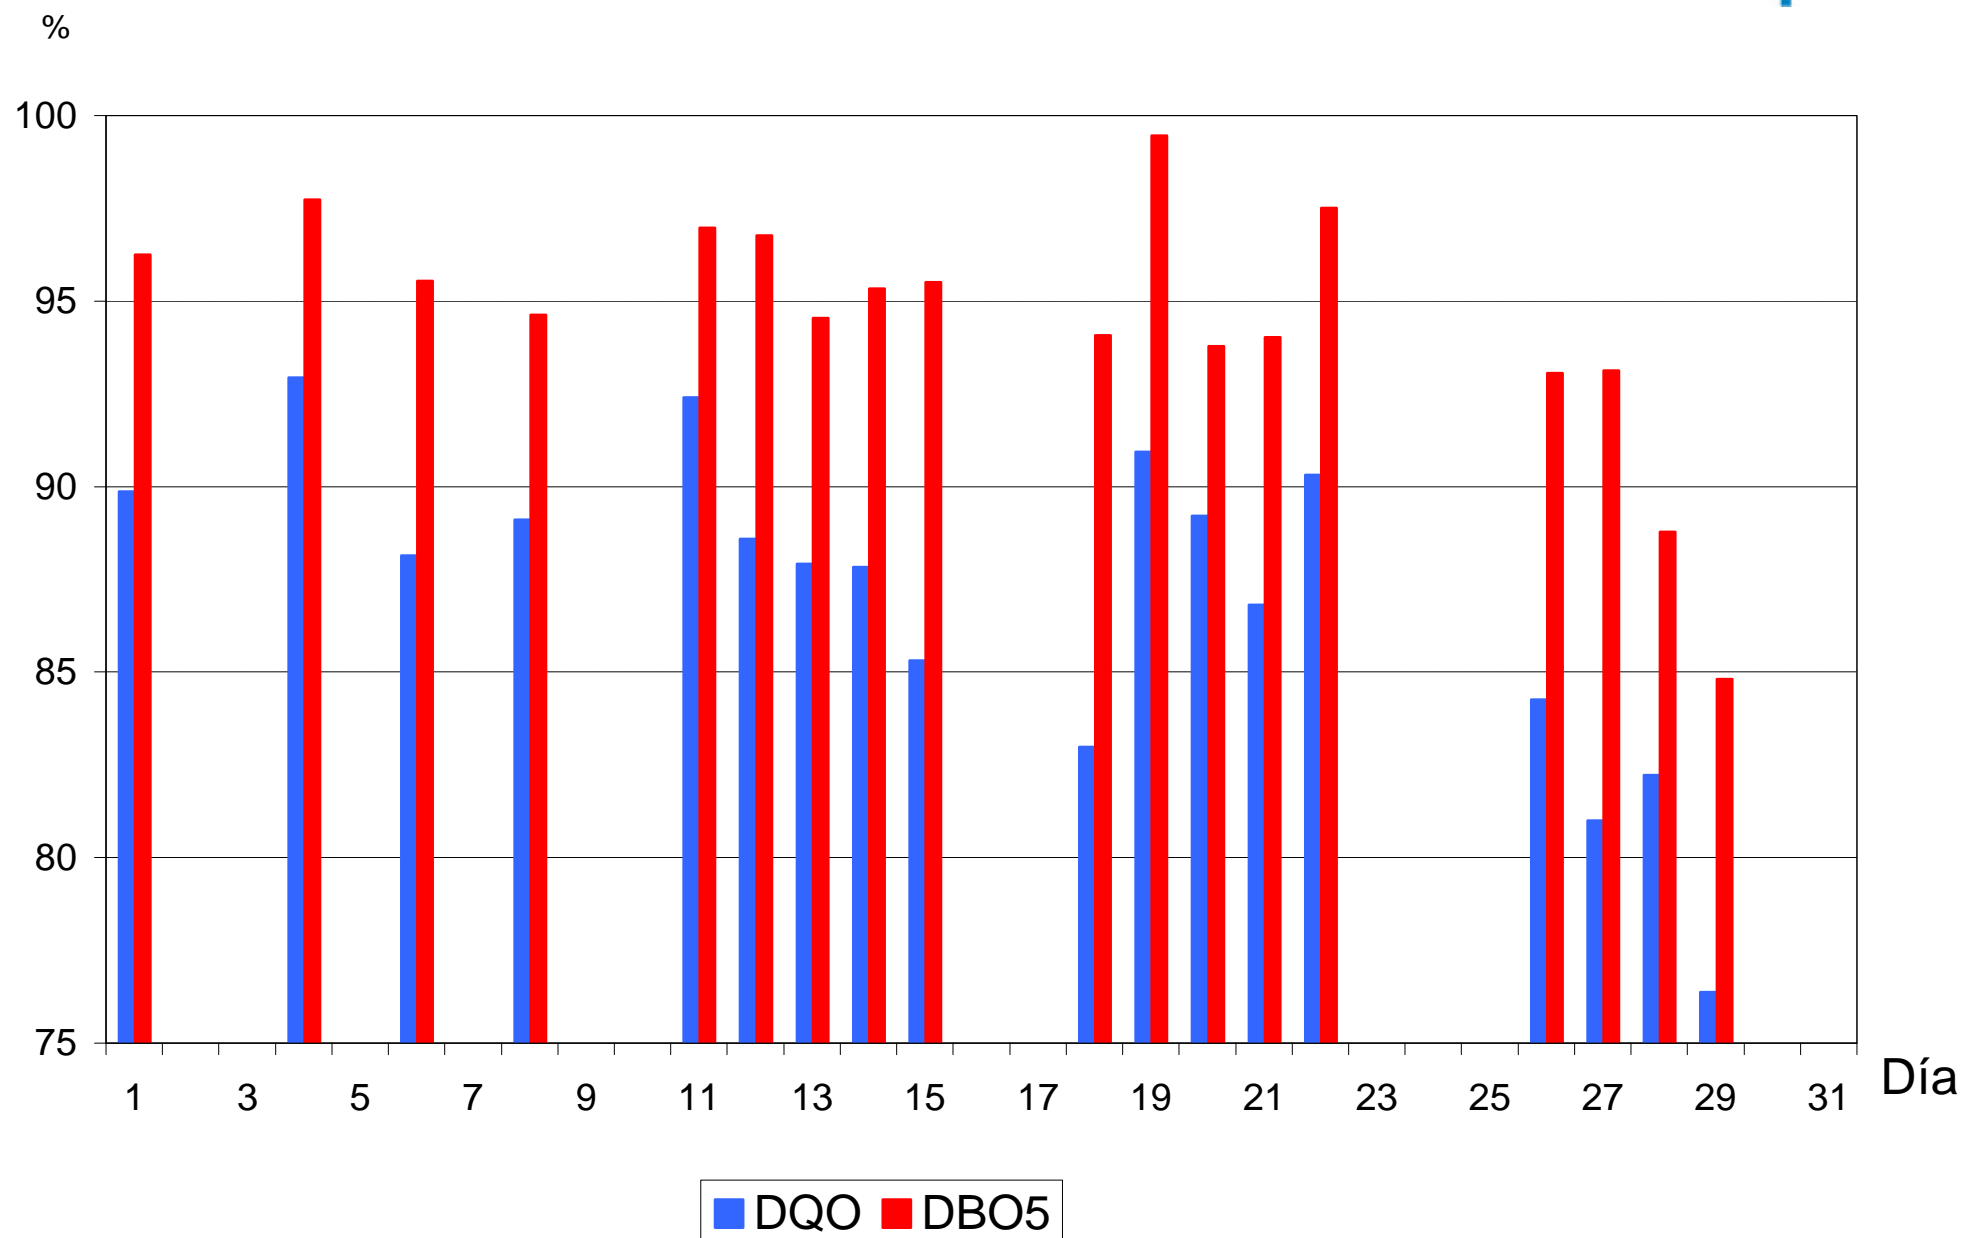

	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	3.493	7,4	436	120	7,3	42	3	90	97
2	3.601								
3	3.788								
4	4.163	7,5	622	340	7,0	81	7	87	98
5	3.709								
6	3.851	7,4	474	146	7,5	71	5	85	97
7	3.847								
8	3.691	7,3	474	146	7,0	77	4	84	97
9	3.724								
10	5.219								
11	3.743	7,7	756	180	8,0	67	24	91	87
12	3.398	7,6	474	300	7,1	78	6	83	98
13	3.620	7,5	637	195	7,4	87	4	86	98
14	3.075	7,3	682	155	7,3	82	4	88	98
15	3.745	7,6	511	127	8,0	86	4	83	97
16	3.330								
17	3.751								
18	3.413	7,4	466	180	7,4	84	9	82	95
19	3.568	7,4	540	260	7,7	109	5	80	98
20	3.486	7,5	518	169	7,3	88	11	83	93
21	3.446	7,5	444	175	7,9	58	5	87	97
22	3.492	7,5	474	218	7,7	89	6	81	97
23	3.681								
24	3.690								
25	3.662								
26	3.692	7,6	420	258	7,8	54	9	87	97
27	3.632	7,6	540	163	7,9	76	5	86	97
28	3.641	7,7	570	138	7,7	83	8	85	94
29	3.704	7,7	414	153	7,9	48	3	88	98
30	3.715								
31	4.429								
MED	3.710	7,5	525	190	7,6	76	7	85	96
MIN	3.075	7,3	414	120	7,0	42	3	80	87
MAX	5.219	7,7	756	340	8,0	109	24	91	98
TOTAL	114.999	-	-	-	-	-	-	-	-

# Rendimientos EDAR La Barrosa - Diciembre'11

