


	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	8.905								
2	8.219	7,2	771	360	7,5	92	33	88	91
3	8.689	7,7	919	400	7,2	93	32	90	92
4	8.506	7,5	927	560	7,6	84	5	91	99
5	8.927								
6	8.440	7,3	815	287	7,8	81	25	90	91
7	12.477								
8	9.046								
9	8.613	7,4	905	540	7,3	84	34	91	94
10	8.834	7,4	1.001	440	7,3	84	15	92	97
11	8.996	7,4	1.061	522	7,1	59	14	94	97
12	9.322	7,2	1.031	395	7,2	63	11	94	97
13	9.285	7,2	1.001	446	7,3	84	13	92	97
14	8.480								
15	8.670								
16	8.562	7,3	852	300	7,5	80	17	91	94
17	8.887	7,5	771	420	7,1	80	18	90	96
18	9.002								
19	9.161	7,2	793	350	7,6	72	16	91	95
20	8.812	7,5	867	431	7,9	75	8	91	98
21	8.868								
22	10.254								
23	6.927								
24	9.397								
25	7.476	7,3	971	600	7,2	84	21	91	97
26	8.378	7,3	919	360	7,2	89	5	90	99
27	8.948	7,3	934	345	7,4	90	14	90	96
28	8.361								
29	8.137								
30	8.226								
31	9.081								
MED	8.835	7,4	909	422	7,4	81	18	91	96
MIN	6.927	7,2	771	287	7,1	59	5	88	91
MAX	12.477	7,7	1.061	600	7,9	93	34	94	99
TOTAL	273.889	-	-	-	-	-	-	-	-

Rendimientos EDAR El Torno - Diciembre'12

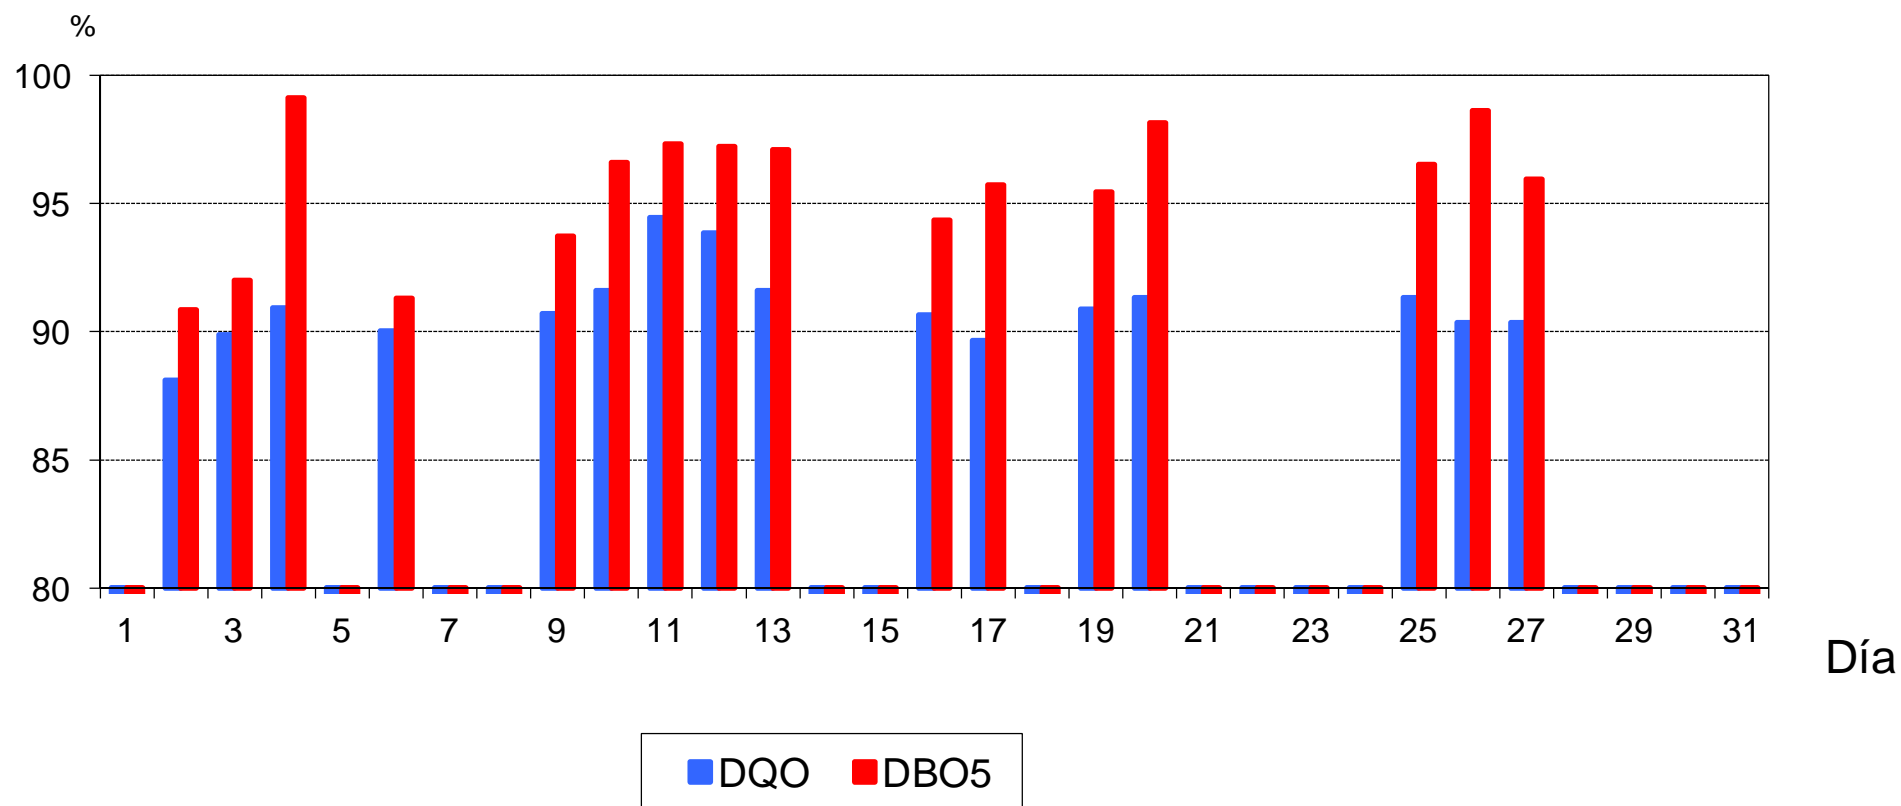

	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	1.913								
2	5.818	7,3	593	260	7,7	59	12	100	100
3	3.567	7,5	540	240	7,9	66	7	88	97
4	3.689	7,6	593	220	8,0	59	7	90	97
5	3.531								
6	4.956	7,5	526	194	8,1	76	4	86	98
7	7.732								
8	4.668								
9	4.311	7,5	704	280	7,4	66	11	91	96
10	3.856	7,8	570	220	7,5	62	5	89	98
11	3.872	7,7	347	153	7,5	32	4	91	98
12	3.942	7,6	429	110	7,6	45	4	89	96
13	3.989	7,8	436	128	7,3	54	5	88	96
14	4.264								
15	4.305								
16	3.889	7,3	481	280	7,7	63	9	87	97
17	3.999	7,3	578	280	7,2	54	7	91	98
18	3.881								
19	3.635	7,5	578	175	7,9	50	0	91	100
20	3.745	7,5	436	146	7,8	64	6	85	96
21	3.593								
22	3.691								
23	3.824								
24	3.977								
25	4.005	7,3	920	240	7,2	59	14	94	94
26	3.851	7,5	607	320	7,2	65	13	89	96
27	3.866	7,5	883	395	7,3	76	8	91	98
28	3.729								
29	3.850								
30	3.658								
31	4.165								
MED	4.057	7,5	576	228	7,6	59	7	90	97
MIN	1.913	7,3	347	110	7,2	32	0	85	94
MAX	7.732	7,8	920	395	8,1	76	14	100	100
TOTAL	125.771	-	-	-	-	-	-	-	-

Rendimientos EDAR La Barrosa - Diciembre'12

