


	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	8.421				7,6	120			
2	8.597	7,4	771	460	7,6	117	4	85	99
3	9.141	7,1	823	506	7,7	92	10	89	98
4	9.220				8,2	138			
5	9.367				7,6	120			
6	7.819				7,3	114			
7	9.539								
8	8.843	7,0	734	240	7,4	99	13	86	95
9	9.130	7,2	800	360	7,6	95	12	88	97
10	8.972	7,5	763	322	7,9	93	18	88	94
11	9.487	7,4	771	228	7,2	92	25	88	89
12	8.445	7,5	763	294	7,5	84	15	89	95
13	8.995								
14	9.239								
15	9.280	7,4	860	540	7,0	111	10	87	98
16	10.681	7,3	748	320	7,1	105	28	86	91
17	9.728	7,2	763	361	7,2	96	28	87	92
18	9.761	7,4	815	350	7,3	104	27	87	92
19	9.324	7,4	711	211	7,3	92	10	87	95
20	9.469								
21	9.247								
22	8.928	7,4	786	300	7,4	83	11	89	96
23	9.126	7,4	786	460	7,2	95	19	88	96
24	9.334	7,3	659	285	7,4	72	13	89	95
25	9.129	7,3	667	415	7,5	93	19	86	95
26	9.868	7,1	830	225	7,3	84	22	90	90
27	10.446								
28	9.178								
29	8.604	7,2	711	420	7,6	89	15	88	96
30	9.138	7,4	674	460	7,7	78	18	88	96
31	8.952	7,4	823	244	7,3	83	8	90	97
MED	9.207	7,3	763	350	7,4	98	16	88	95
MIN	7.819	7,0	659	211	7,0	72	4	85	89
MAX	10.681	7,5	860	540	8,2	138	28	90	99
TOTAL	285.406	-	-	-	-	-	-	-	-

# Rendimientos EDAR El Torno - Enero'12

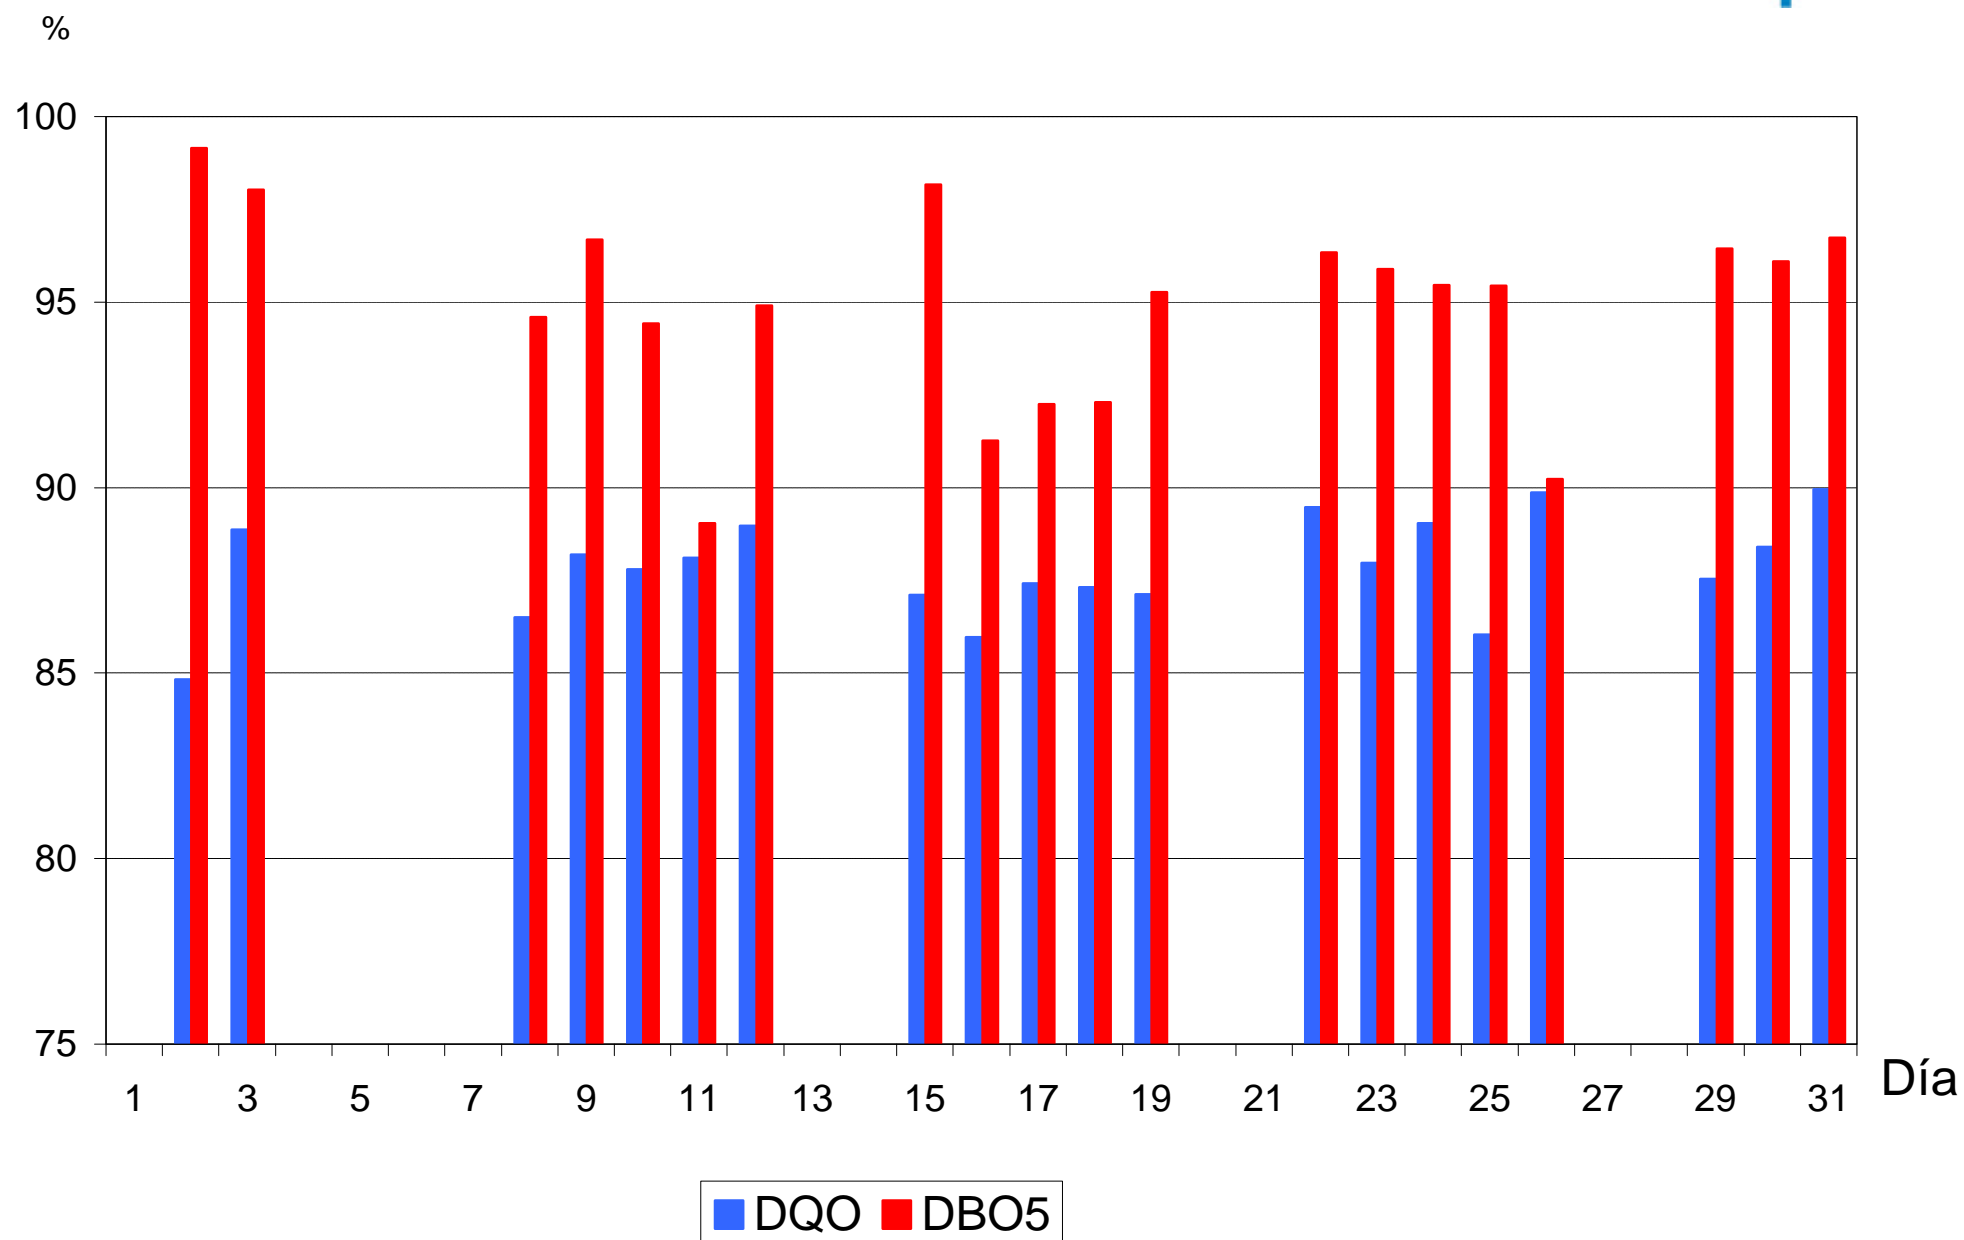

	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	3.491								
2	3.502	7,6	749	280	8,0	80	7	89	98
3	3.730	7,4	593	250	7,8	76	12	87	95
4	3.914								
5	3.662								
6	3.372								
7	3.893								
8	3.793	7,3	511	220	7,3	79	12	85	94
9	3.509	7,4	593	240	7,5	84	23	86	90
10	4.144	7,4	585	218	7,9	87	11	85	95
11	4.026	7,6	593	155	7,4	87	12	85	93
12	4.136	7,6	578	254	7,4	83	16	86	94
13	3.981								
14	4.037								
15	6.185	7,5	421	300	7,2	65	14	85	95
16	9.086	7,1	533	260	7,0	87	13	84	95
17	4.710	7,3	407	197	7,2	85	13	79	94
18	4.235	7,4	607	250	7,3	83	7	86	97
19	4.215	7,4	436	127	7,3	84	8	81	93
20	3.409								
21	4.284								
22	4.186	7,3	689	340	7,4	86	20	88	94
23	4.156	7,5	488	300	7,3	79	11	84	96
24	4.003	7,4	444	167	7,6	83	11	81	93
25	4.239	7,7	414	121	7,4	83	12	80	90
26	4.347	7,3	593	173	7,2	82	8	86	95
27	4.920								
28	4.130								
29	3.980	7,2	756	340	7,1	80	15	89	96
30	3.563	7,4	689	340	7,4	76	17	89	95
31	3.520	7,5	511	138	7,3	82	4	84	97
MED	4.205	7,4	559	234	7,4	82	12	85	94
MIN	3.372	7,1	407	121	7,0	65	4	79	90
MAX	9.086	7,7	756	340	8,0	87	23	89	98
TOTAL	130.358	-	-	-	-	-	-	-	-

# Rendimientos EDAR La Barrosa - Enero'12

