


	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	8.391	7,3	637	360	7,1	84	25	87	93
2	8.472	7,3	882	368	7,1	81	11	91	97
3	8.149	6,9	964	356	7,2	92	12	90	97
4	8.486	7,0	949	294	7,5	93	20	90	93
5	8.394								
6	6.873								
7	6.035	7,0	681	440	7,4	96	30	86	93
8	7.296	7,1	756	460	7,5	105	22	86	95
9	7.993	7,1	377	194	7,2	46	14	88	93
10	7.818	7,2	473	253	7,1	105	26	78	90
11	8.008	7,2	414	223	7,8	47	9	89	96
12	8.137								
13	8.200								
14	7.026	7,3	414	260	7,5	68	15	84	94
15	7.941	7,1	808	340	7,6	84	22	90	94
16	8.582	7,2	875	331	7,7	87	11	90	97
17	7.645	6,9	942	381	7,4	80	18	92	95
18	8.518	7,1	830	325	7,2	84	18	90	94
19	7.660								
20	7.580								
21	7.219	7,2	830	300	7,4	93	20	89	93
22	8.354	7,0	808	320	7,2	69	19	91	94
23	8.123	7,1	1.083	349	7,6	74	14	93	96
24	7.959								
25	8.457								
26	8.376								
27	7.699								
28	7.617								
29	8.168	7,0	964	320	7,4	68	23	93	93
30	7.895	7,3	964	280	7,2	96	15	90	95
31	7.870	6,9	1.038	660	7,2	98	17	91	97
MED	7.901	7,1	784	341	7,4	83	18	89	94
MIN	6.035	6,9	377	194	7,1	46	9	78	90
MAX	8.582	7,3	1.083	660	7,8	105	30	93	97
TOTAL	244.942	-	-	-	-	-	-	-	-

## Rendimientos EDAR El Torno - Julio'13

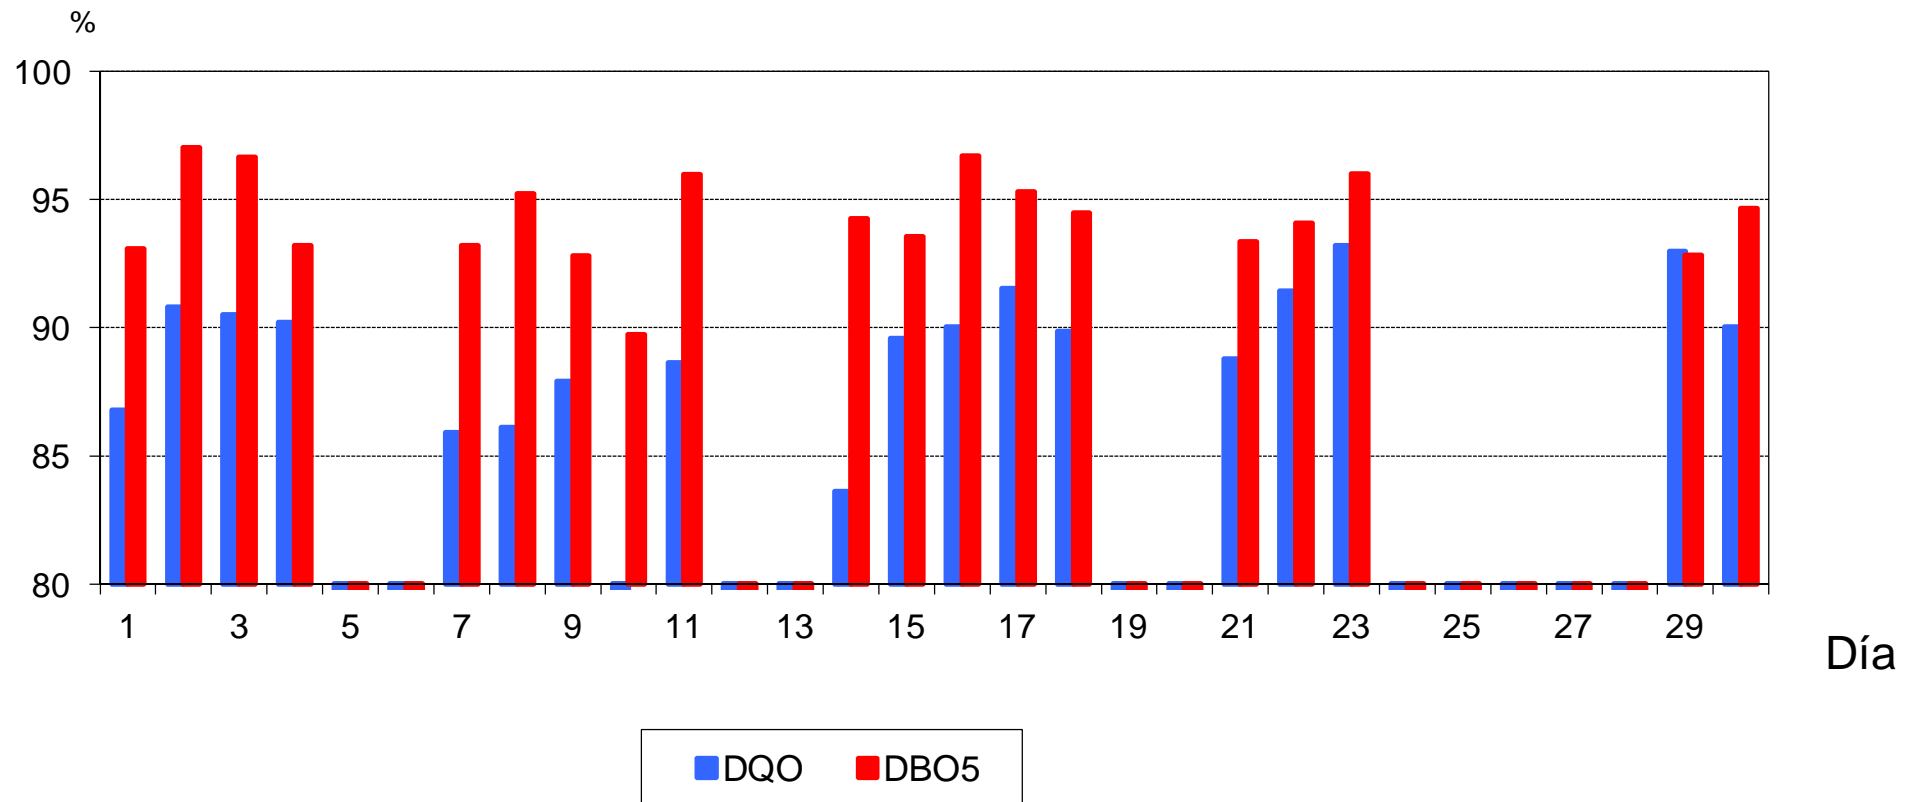

	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	9.775	7,7	540	260	7,4	74	21		
2	8.505	7,2	503	261	7,4	62	9	79	91
3	8.663	7,1	712	296	7,3	75	10	83	93
4	8.646	7,5	615	147	7,2	84	11	90	96
5	8.744							89	95
6	9.244							86	94
7	10.037	7,0	741	180	7,4	100	16		
8	8.594	7,3	496	340	7,7	49	10		
9	9.156	7,2	295	139	7,4	55	5	88	96
10	9.200	7,2	429	217	7,2	59	7	91	89
11	9.407	7,2	302	161	7,2	29	5	87	92
12	9.675							91	99
13	9.887								
14	9.289	7,1	362	220	7,4	56	5		
15	9.137	7,5	987	360	7,2	77	20		
16	9.214	7,3	860	296	7,6	74	11	92	94
17	9.271	7,2	831	294	7,5	75	8	88	95
18	9.535	7,0	637	173	7,3	71	14	88	94
19	10.180							90	92
20	10.030							92	96
21	9.949	7,5	764	300	7,5	77	21		
22	9.822	7,5	875	360	7,1	67	16		
23	9.916	7,4	533	222	7,8	68	9	94	95
24	10.358							88	95
25	10.202							87	96
26	9.601							87	92
27	10.011							91	98
28	10.103								
29	9.521	7,4	674	340	7,8	62	17		
30	9.533	7,4	548	320	7,8	85	12	91	93
31	9.589	7,3	719	380	7,2	89	29		
MED	9.509	7,3	621	263	7,4	70	13	89	94
MIN	8.505	7,0	295	139	7,1	29	5	79	89
MAX	10.358	7,7	987	380	7,8	100	29	94	99
TOTAL	294.794	-	-	-	-	-	-	-	-

## Rendimientos EDAR La Barrosa - Julio'13

