


	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	7.755	7,4	1.023	400	7,4	95	39	91	90
2	8.656	7,4	942	520	7,5	92	20	90	96
3	8.487	7,4	875	443	7,4	99	13	89	97
4	8.549	7,4	1.009	344	7,2	77	9	92	97
5	9.141								
6	8.212								
7	8.034								
8	8.025								
9	8.026	7,2	793	500	7,3	80	15	90	97
10	7.699	7,4	927	560	7,4	80	13	91	98
11	8.380	7,5	971	157	7,6	92	17	91	89
12	8.193								
13	9.533								
14	7.317								
15	7.031	7,3	696	480	7,3	89	15	87	97
16	8.367	7,1	815	440	7,0	74	16	91	96
17	9.520	7,3	719	389	7,6	96	21	87	95
18	8.933	7,3	622	227	7,1	81	11	87	95
19	9.047								
20	8.667								
21	8.667								
22	8.667	7,4	830	540	7,2	93	20	89	96
23	8.420								
24	9.637								
25	9.637	7,3	882	340	6,9	93	33	89	90
26	8.777	7,7	897	356	7,4	89	11	90	97
27	11.022								
28	8.589								
29	8.582	7,2	793	380	7,5	86	15	89	96
30	9.364								
31	9.736								
MED	8.667	7,4	853	405	7,3	88	18	90	95
MIN	7.031	7,1	622	157	6,9	74	9	87	89
MAX	11.022	7,7	1.023	560	7,6	99	39	92	98
TOTAL	268.669	-	-	-	-	-	-	-	-

Rendimientos EDAR El Torno - Diciembre'13

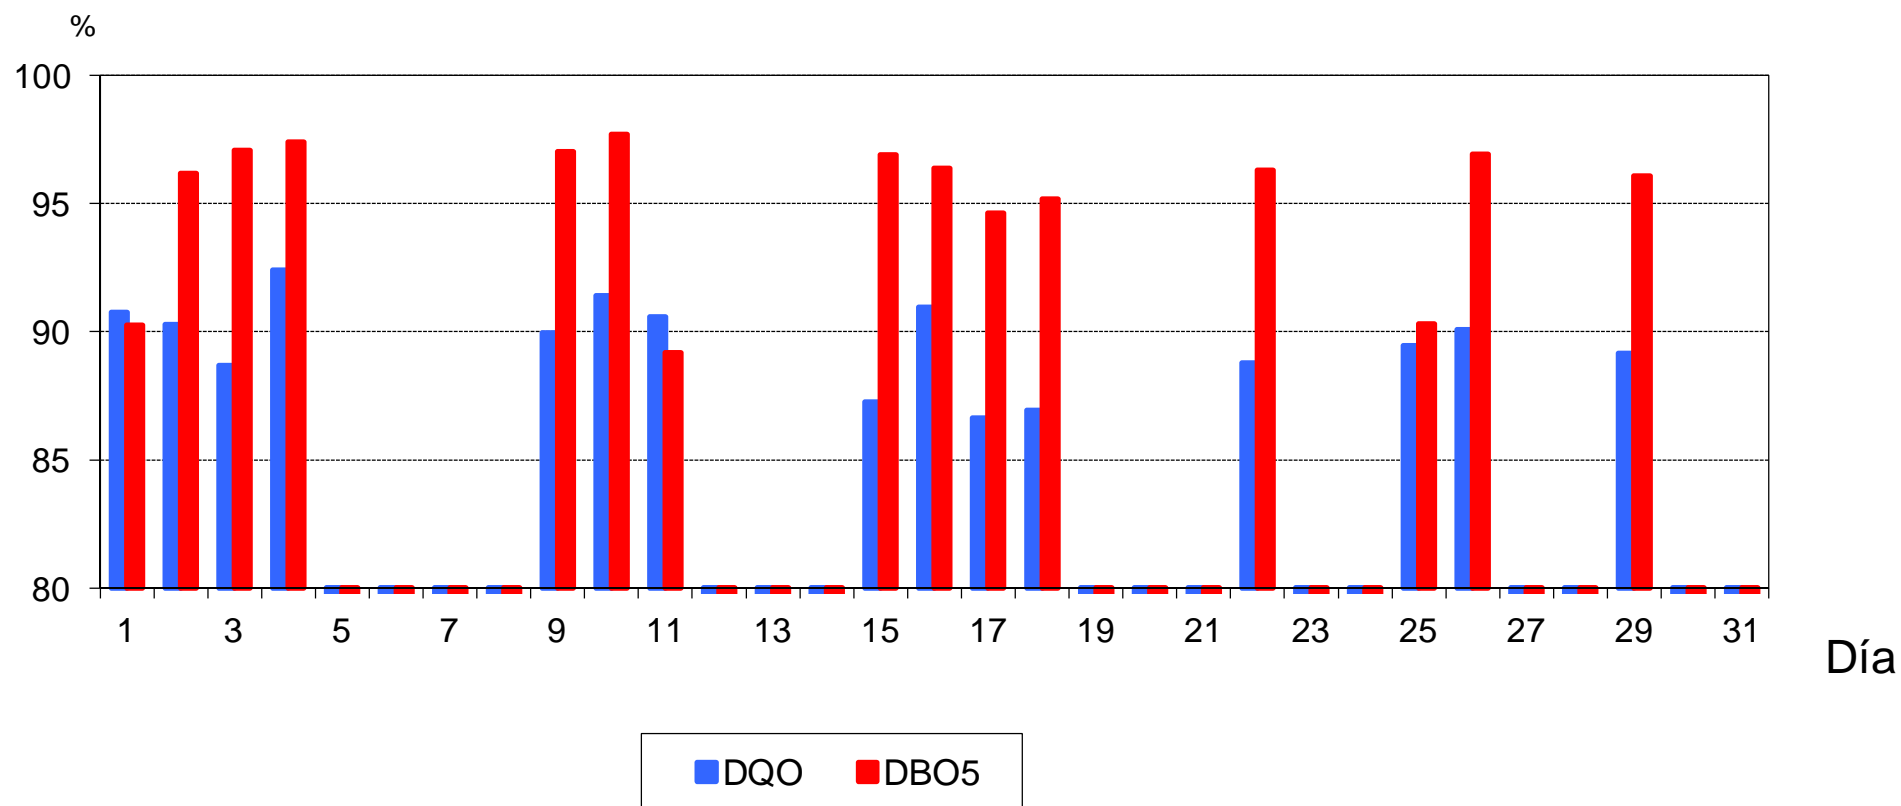

	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	3.358	7,3	674	260	7,3	63	17	91	93
2	3.618	7,4	868	400	7,7	77	16	91	96
3	3.612	7,5	712	195	7,4	51	4	93	98
4	3.655	7,5	905	189	7,6	61	4	93	98
5	3.631								
6	3.690								
7	3.964								
8	3.823								
9	3.715	7,4	667	360	7,4	77	13	88	96
10	3.421	7,5	630	300	7,2	52	6	92	98
11	3.232	7,6	875	173	7,9	50	3	94	98
12	3.257								
13	3.326								
14	3.393								
15	3.296	7,4	630	280	7,4	78	34	88	88
16	3.197	7,3	622	300	7,2	52	5	92	98
17	3.451	7,4	548	127	7,9	63	9	88	93
18	3.397	7,4	570	174	7,3	65	5	89	97
19	5.226								
20	3.391								
21	3.077								
22	3.096	7,1	459	340	7,4	59	30	87	91
23	3.164								
24	4.568								
25	8.605	7,1	741	320	6,8	68	15	91	95
26	4.386	7,6	808	416	7,8	85	13	90	97
27	4.107								
28	5.310								
29	3.660	7,2	741	360	7,2	76	9	90	98
30	3.633								
31	3.969								
MED	3.846	7,4	697	280	7,4	65	12	90	96
MIN	3.077	7,1	459	127	6,8	50	3	87	88
MAX	8.605	7,6	905	416	7,9	85	34	94	98
TOTAL	119.228	-	-	-	-	-	-	-	-

Rendimientos EDAR La Barrosa - Diciembre13

