


	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	7.794								
2	7.945								
3	7.806								
4	6.922	7,1	890	580	7,4	96	25	89	96
5	7.898	7,1	979	440	7,3	96	30	90	93
6	7.946	7,0	942	313	7,4	95	8	90	97
7	7.953	7,2	1.068	293	7,4	90	10	92	97
8	7.759	7,1	786	254	7,3	99	10	87	96
9	8.215								
10	7.351								
11	7.501	6,9	942	660	7,0	84	30	91	95
12	8.327	7,3	1.053	520	7,4	77	21	93	96
13	7.838	7,0	1.083	575	7,4	92	11	92	98
14	8.038								
15	6.645	6,8	905	278	7,4	102	11	89	96
16	8.203								
17	7.773								
18	7.192	7,3	1.031	520	7,1	80	20	92	96
19	7.608	7,4	1.001	400	7,8	86	20	91	95
20	7.978	7,5	927	600	7,1	87	14	91	98
21	8.118	7,1	689	242	7,6	96	11	86	95
22	8.363	7,3	875	277	7,6	86	3	90	99
23	8.615								
24	7.853								
25	7.563	7,3	830	480	7,5	83	16	90	97
26	8.049	7,1	838	340	7,2	89	20	89	94
27	7.384	7,2	1.120	256	7,2	90	6	92	98
28	7.989	7,1	994	310	7,5	63	12	94	96
29	8.420	7,2	719	221	7,2	63	7	91	97
30	7.117								
31	6.084								
MED	7.750	7,2	930	398	7,4	87	15	90	96
MIN	6.084	6,8	689	221	7,0	63	3	86	93
MAX	8.615	7,5	1.120	660	7,8	102	30	94	99
TOTAL	240.248	-	-	-	-	-	-	-	-

Rendimientos EDAR El Torno - Agosto'13

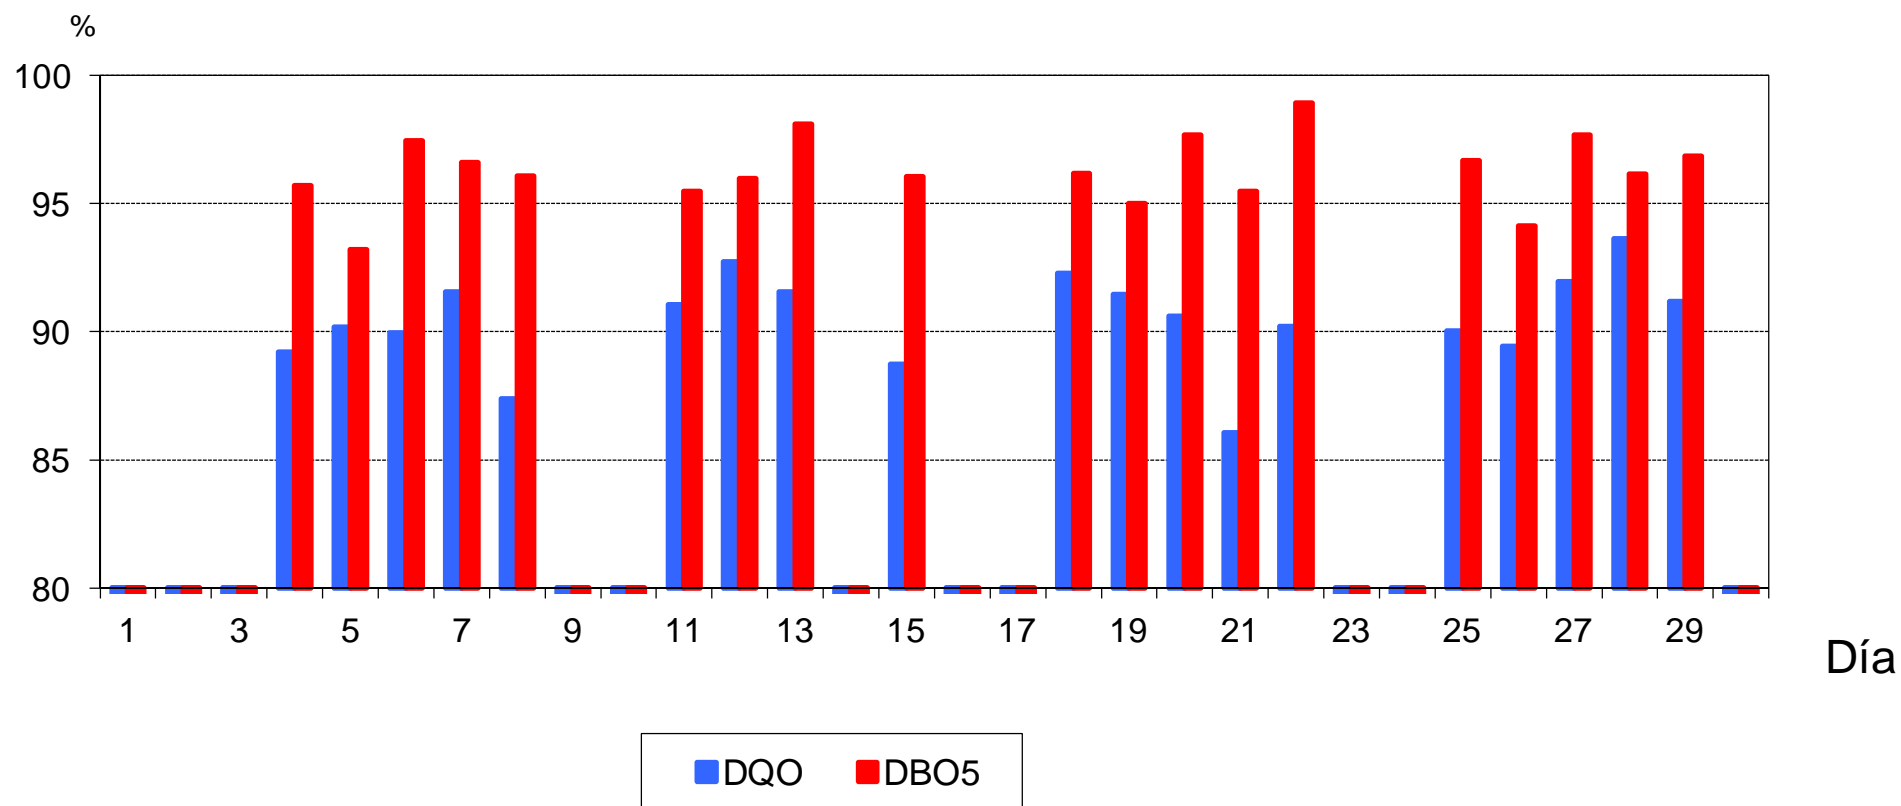

	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	9.462								
2	10.416								
3	10.512								
4	10.727	7,2	1.069	400	7,3	87	17	92	96
5	10.725	7,3	697	400	7,6	91	25	87	94
6	10.589	7,4	697	263	7,4	90	10	87	96
7	10.453	7,4	816	244	7,7	88	11	89	95
8	10.804	7,3	682	223	7,4	86	6	87	97
9	10.801								
10	10.830								
11	10.963	7,1	793	400	6,9	98	24	88	94
12	10.864	7,2	927	380	7,7	83	18	91	95
13	10.441	7,1	726	303	7,2	75	7	90	98
14	11.260								
15	10.786	6,9	793	273	7,0	93	8	88	97
16	11.217								
17	11.164								
18	10.576	7,6	816	340	7,5	72	17	91	95
19	10.756	7,6	749	360	8,0	119	36	84	90
20	11.280	7,1	734	320	7,5	78	22	89	93
21	11.591	7,4	771	251	7,3	80	4	90	98
22	11.531	7,6	697	199	7,4	89	8	87	96
23	11.599								
24	10.264								
25	10.771	7,5	660	300	7,8	89	19	86	94
26	10.008	7,3	719	320	7,3	84	18	88	94
27	9.880	7,3	756	236	7,4	78	7	90	97
28	10.312	7,3	771	203	7,5	73	5	91	98
29	10.148	7,1	660	244	7,3	72	6	89	98
30	9.994								
31	9.033								
MED	10.637	7,3	765	298	7,4	86	14	89	96
MIN	9.033	6,9	660	199	6,9	72	4	84	90
MAX	11.599	7,6	1.069	400	8,0	119	36	92	98
TOTAL	329.757	-	-	-	-	-	-	-	-

Rendimientos EDAR La Barrosa - Agosto'13

