


	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	5.566	7,1	719	360	7,3	87	26	88	93
2	5.933	7,5	830	660	7,4	96	15	88	98
3	6.082	7,2	1.046	440	7,6	75	16	93	96
4	6.956	7,0	927	286	7,1	86	8	91	97
5	7.453	7,3	823	277	7,7	77	7	91	97
6	7.645								
7	7.645								
8	7.465	7,2	882	540	7,3	93	15	89	97
9	7.773	7,2	533	260	6,9	92	25	83	90
10	8.127	7,1	793	324	7,0	86	10	89	97
11	7.960	7,0	882	248	7,0	99	9	89	96
12	8.039	7,1	607	146	7,8	49	3	92	98
13	9.123								
14	15.467								
15	8.120	7,1	815	660	7,1	60	18	93	97
16	7.968	7,1	741	500	7,4	68	29	91	94
17	7.927	7,3	756	272	7,3	60	4	92	99
18	8.194	7,1	919	343	7,3	60	6	93	98
19	7.959	6,8	838		7,0	124		85	
20	7.959	7,0	793		7,0	99		88	
21	7.961	6,9	704		7,1	95		87	
22	7.916	7,1	830	340	7,2	107	20	87	94
23	7.832	7,2	867	540	7,5	81	33	91	94
24	8.012	7,0	971	305	7,4	215	39	78	87
25	7.952	7,0	875	338	7,1	93	35	89	90
26	4.863	7,2	778	291	7,2	151	21	81	93
27	4.863								
28	9.118								
29	6.720	7,3	518	330	7,0	74	18	86	95
30	8.936								
MED	7.784	7,1	802	373	7,2	93	18	88	95
MIN	4.863	6,8	518	146	6,9	49	3	78	87
MAX	15.467	7,5	1.046	660	7,8	215	39	93	99
TOTAL	233.533	-	-	-	-	-	-	-	-

Rendimientos EDAR El Torno - Septiembre'13

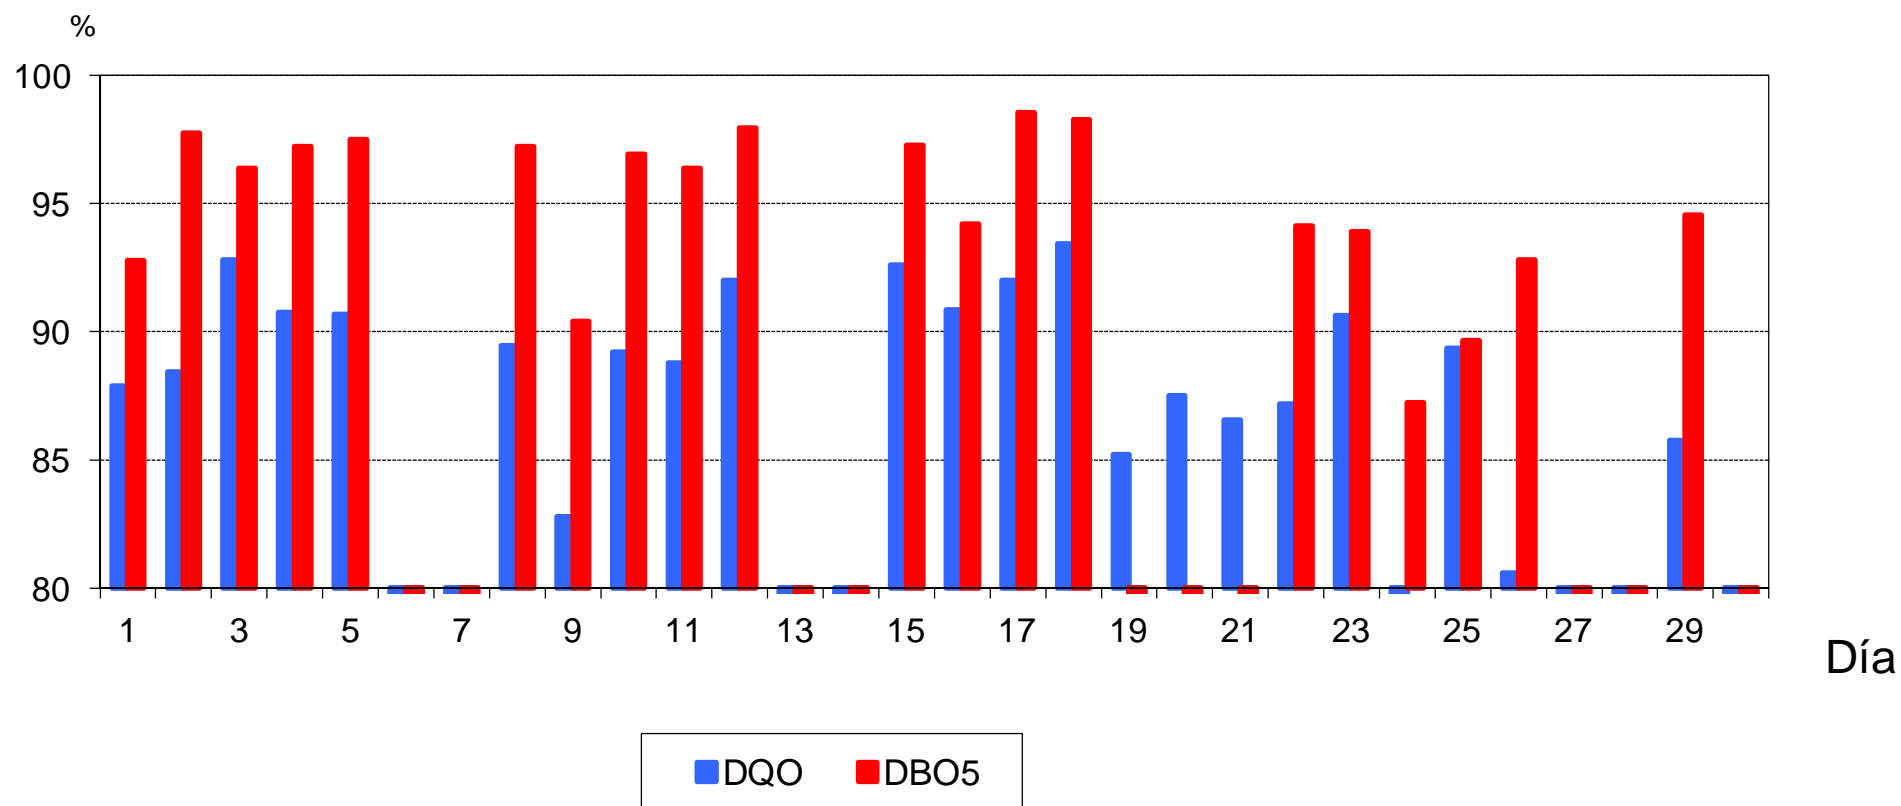

	Caudal entrada	AGUA BRUTA			AGUA TRATADA			REND. ELIMINACION	
		pH	D.Q.O.	D.B.O.5	pH	D.Q.O.	D.B.O.5	D.Q.O.	D.B.O.5
Día	m3/día	-	mg/l	mg/l	-	mg/l	mg/l	%	%
1	9.008	7,2	667	300	7,5	81	20	88	93
2	8.236	7,7	704	540	7,7	84	11	88	98
3	8.013	7,4	1.039	500	7,8	82	18	92	96
4	7.877	7,3	712	250	7,1	86	6	88	98
5	8.315	7,8	652	197	7,8	74	6	89	97
6	8.105								
7	8.577								
8	8.012	7,2	838	500	7,4	80	10	90	98
9	7.480	7,2	712	340	7,1	80	15	89	96
10	7.144	7,2	712	211	7,1	88	10	88	95
11	7.039	7,1	845	207	7,1	79	4	91	98
12	7.028	7,4	474	95	8,1	34	3	93	97
13	7.113								
14	7.584								
15	6.896	7,2	607	500	7,8	58	21	90	96
16	6.889	7,3	660	340	7,8	89	25	86	93
17	6.598	7,3	570	203	7,5	63	4	89	98
18	7.840	7,4	689	200	7,4	61	8	91	96
19	6.677								
20	6.089								
21	4.719								
22	6.470	7,1	607	400	7,1	70	22	89	94
23	6.495	7,4	779	420	7,5	77	23	90	95
24	7.126	7,2	905	251	7,6	55	2	94	99
25	6.178	7,2	540	211	7,1	48	5	91	97
26	6.343	7,1	652	271	7,0	45	2	93	99
27	8.524								
28	6.967								
29	9.067	7,2	749	303	7,1	69	9	91	97
30	6.248								
MED	7.289	7,3	706	312	7,4	70	11	90	97
MIN	4.719	7,1	474	95	7,0	34	2	86	93
MAX	9.067	7,8	1.039	540	8,1	89	25	94	99
TOTAL	218.657	-	-	-	-	-	-	-	-

Rendimientos EDAR La Barrosa - Septiembre'13

